

## Comal County

OFFICE OF COMAL COUNTY ENGINEER

### License to Operate On-Site Sewage Treatment and Disposal Facility

Issued This Date: 03/05/2019

Permit Number: 108031

Location Description: 108 PARADISE HILLS  
NEW BRAUNFELS, TX 78132

Subdivision: River Chase  
Unit: 8  
Lot: 1347  
Block:  
Acreage:

Type of System: Aerobic  
Surface Irrigation

Issued to: Kenneth & Sharon Dearmond

This license is authorization for the owner to operate and maintain a private facility at the location described in accordance to the rules and regulations for on-site sewerage facilities of Comal County, Texas, and the Texas Commission on Environmental Quality.

The license grants permission to operate the facility. It does not guarantee successful operation. It is the responsibility of the owner to maintain and operate the facility in a satisfactory manner.

Alterations to this permit including, but not limited to:

- Increase in the square feet of living area
- Increase in the number of bedrooms
- A change of use (i.e. residential to commercial)
- Relocation of system components (including the relocation of spray heads)
- Installation of landscaping
- Adding new structures to the system

may require a new permit. **It is the responsibility of the owner to apply for a new permit, if applicable.**

Inspection and licensing of a facility indicates only that the facility meets certain minimum requirements. It does not impede any governmental entity in taking the proper steps to prevent or control pollution, to abate nuisance, or to protect the public health.

This license to operate is valid for an indefinite period. The holder may transfer it to a succeeding owner, provided the facility has not been remodeled and is functioning properly.

Licensing Authority

Comal County Environmental Health

ENVIRONMENTAL HEALTH INSPECTOR

ENVIRONMENTAL HEALTH COORDINATOR

OS 0025599

OS0034322



# Comal County Environmental Health

## OSSF Inspection Sheet

Installer Name: M.J. Septic OSSF Installer #: 050025596  
 1st Inspection Date: 1-9-19 2nd Inspection Date: 1-11-19 3rd Inspection Date: 3-5-19  
 Inspector Name: Connor Inspector Name: Connor Inspector Name: Andrea J  
 Permit #: 108031 Address: River Chase 108 Paradise Hills

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
1	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Site and Soil Conditions Consistent with Submitted Planning Materials	/	285.31(a) 285.30(b)(1)(A)(iv) 285.30(b)(1)(A)(v) 285.30(b)(1)(A)(iii) 285.30(b)(1)(A)(ii) 285.30(b)(1)(A)(i)		/		
2	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Setback Distances Meet Minimum Standards	/	285.91(10) 285.30(b)(4) 285.31(d)		/		
3	SEWER PIPE Proper Type Pipe from Structure to Disposal System (Cast Iron, Ductile Iron, Sch. 40, SDR 26)	/	285.32(a)(1)		/		
4	SEWER PIPE Slope from the Sewer to the Tank at least 1/8 Inch Per Foot	/	285.32(a)(3)		/		
5	SEWER PIPE Two Way Sanitary - Type Cleanout Properly Installed (Add. C/O Every 100' &/or 90 degree bends)	/	285.32(a)(5)		/		
6	PRETREATMENT installed (if required) TCEQ Approved List PRETREATMENT Septic Tank(s) Meet Minimum Requirements		285.32(b)(1)(G)285.32(b)(1)(E)(iii) 285.32(b)(1)(E)(iv) 285.32(b)(1)(F) 285.32(b)(1)(B) 285.32(b)(1)(C)(i) 285.32(b)(1)(C)(ii) 285.32(b)(1)(D) 285.32(b)(1)(E) 285.32(b)(1)(A) 285.32(b)(1)(E)(ii)(II) 285.32(b)(1)(E)(i) 285.32(b)(1)(E)(ii)(I)				
7	PRETREATMENT Grease Interceptors if required for commercial		285.34(d)				

tank set level leaking opposite of house mid line  
 patch, reschedule tank check (tank) Patched - cover - 1-11-19

3-5-19

covered operation



# Comal County Environmental Health

## OSSF Inspection Sheet

Installer Name: MJ Septic      OSSF Installer #: 050025596  
 1st Inspection Date: 1-9-19      2nd Inspection Date: \_\_\_\_\_      3rd Inspection Date: \_\_\_\_\_  
 Inspector Name: Connor      Inspector Name: \_\_\_\_\_      Inspector Name: \_\_\_\_\_  
 Permit#: 108031      Address: River Chase 108 Paradise Hills

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
1	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Site and Soil Conditions Consistent with Submitted Planning Materials	/	285.31(a) 285.30(b)(1)(A)(iv) 285.30(b)(1)(A)(v) 285.30(b)(1)(A)(iii) 285.30(b)(1)(A)(ii) 285.30(b)(1)(A)(i)		/		
2	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Setback Distances Meet Minimum Standards	/	285.91(10) 285.30(b)(4) 285.31(d)		/		
3	SEWER PIPE Proper Type Pipe from Structure to Disposal System (Cast Iron, Ductile Iron, Sch. 40, SDR 26)	/	285.32(a)(1)		/		
4	SEWER PIPE Slope from the Sewer to the Tank at least 1/8 Inch Per Foot	/	285.32(a)(3)		/		
5	SEWER PIPE Two Way Sanitary - Type Cleanout Properly Installed (Add. C/O Every 100' &/or 90 degree bends)	/	285.32(a)(5)		/		
6	PRETREATMENT Installed (if required) TCEQ Approved List PRETREATMENT Septic Tank(s) Meet Minimum Requirements		285.32(b)(1)(G)285.32(b)(1)(E)(iii) 285.32(b)(1)(E)(iv) 285.32(b)(1)(F) 285.32(b)(1)(B) 285.32(b)(1)(C)(i) 285.32(b)(1)(C)(ii) 285.32(b)(1)(D) 285.32(b)(1)(E) 285.32(b)(1)(A) 285.32(b)(1)(E)(ii)(II) 285.32(b)(1)(E)(i) 285.32(b)(1)(E)(ii)(I)				
7	PRETREATMENT Grease Interceptors if required for commercial		285.34(d)				

tank set level leaking opposite of house mid line  
 patch, reschedule tank check (tank)



**Comal County Environmental Health  
OSSF Inspection Sheet**

Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
SEPTIC TANK Tank(s) Clearly Marked SEPTIC TANK If Single Tank, 2 Compartments Provided with Baffle SEPTIC TANK Inlet Flowline Greater than 3" and " T " Provided on Inlet and Outlet SEPTIC TANK Septic Tank(s) Meet Minimum Requirements		285.32(b)(1)(E) 285.91(2) 285.32(b)(1)(F) 285.32(b)(1)(E)(iii) 285.32(b)(1)(E)(ii)(II) 285.32(b)(1)(E)(ii)(I) 285.32(b)(1)(E)(i) 285.32(b)(1)(D) 285.32(b)(1)(C)(ii) 285.32(b)(1)(C)(i) 285.32(b)(1)(B) 285.32(b)(1)(A) 285.32(b)(1)(E)(iv)				
ALL TANKS Installed on 4" Sand Cushion/ Proper Backfill Used	✓	285.32(b)(1)(F) 285.32(b)(1)(G) 285.34(b)		✓		
SEPTIC TANK Inspection / Clean Out Port & Risers Provided on Tanks Buried Greater than 12" Sealed and Capped		285.38(d)				
SEPTIC TANK Secondary restraint system provided SEPTIC TANK Riser permanently fastened to lid or cast into tank SEPTIC TANK Riser cap protected against unauthorized intrusions		285.38(d) 285.38(e)				
SEPTIC TANK Tank Volume Installed						
PUMP TANK Volume Installed						
AEROBIC TREATMENT UNIT Size Installed	✓			✓		
AEROBIC TREATMENT UNIT Manufacturer AEROBIC TREATMENT UNIT Model Number	✓		Pwflo5060 HCSB	✓		
DISPOSAL SYSTEM Absorptive		285.33(a)(4) 285.33(a)(1) 285.33(a)(2) 285.33(a)(3)				
DISPOSAL SYSTEM Leaching Chamber		285.33(a)(1) 285.33(a)(3) 285.33(a)(4) 285.33(a)(2)				
DISPOSAL SYSTEM Evapo-transpirative		285.33(a)(3) 285.33(a)(4) 285.33(a)(1) 285.33(a)(2)				



**Comal County Environmental Health  
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
19	DISPOSAL SYSTEM Drip Irrigation		285.33(a)(1) 285.33(a)(3) 285.33(a)(4) 285.33(a)(2)				
20	DISPOSAL SYSTEM Soil Substitution		285.33(d)(4)				
21	DISPOSAL SYSTEM Pumped Effluent		285.33(a)(4) 285.33(a)(3) 285.33(a)(1)				
22	DISPOSAL SYSTEM Gravelless Pipe		285.33(a)(3) 285.33(a)(2) 285.33(a)(4) 285.33(a)(1)				
23	DISPOSAL SYSTEM Mound		285.33(a)(3) 285.33(a)(1) 285.33(a)(2) 285.33(a)(4)				
24	DISPOSAL SYSTEM Other (describe) (Approved Design)	/	285.33(d)(6) 285.33(c)(4)	<i>aerobic spray</i>	/		
25	DRAINFIELD Absorptive Drainline 3" PVC or 4" PVC						
26	DRAINFIELD Area Installed						
27	DRAINFIELD Level to within 1 inch per 25 feet and within 3 inches over entire excavation		285.33(b)(1)(A)(v)				
28	DRAINFIELD Excavation Width DRAINFIELD Excavation Depth DRAINFIELD Excavation Separation DRAINFIELD Depth of Porous Media DRAINFIELD Type of Porous Media						
29	DRAINFIELD Pipe and Gravel - Geotextile Fabric in Place		285.33(b)(1)(E)				
30	DRAINFIELD Leaching Chambers DRAINFIELD Chambers - Open End Plates w/Splash Plate, Inspection Port & Closed End Plates in Place (per manufacturers spec.)		285.33(c)(2)				
31	LOW PRESSURE DISPOSAL SYSTEM Adequate Trench Length & Width, and Adequate Separation Distance between Trenches		285.33(d)(1)(C)(i)				




**Comal County Environmental Health  
OSSF Inspection Sheet**

Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
EFFLUENT DISPOSAL SYSTEM Utilized Only by Single Family Dwelling EFFLUENT DISPOSAL SYSTEM Topographic Slopes < 2.0% EFFLUENT DISPOSAL SYSTEM Adequate Length of Drain Field ( 1000 Linear ft. for 2 bedrooms or Less & an additional 400 ft. for each additional bedroom ) EFFLUENT DISPOSAL SYSTEM Lateral Depth of 18 inches to 3 ft. & Vertical Separation of 1ft on bottom and 2 ft. to restrictive horizon and ground water respectfully EFFLUENT DISPOSAL SYSTEM Lateral Drain Pipe (1.25 - 1.5" dia.) & Pipe Holes ( 3/16 - 1/4" dia. Hole Size ) 5 ft. Apart		285.33(b)(3)(A) 285.33(b)(3)(A) 285.33(b)(3)(B) 285.91(13) 285.33(b)(3)(D) 285.33(b)(3)(F)				
AEROBIC TREATMENT UNIT Is Aerobic Unit Installed According to Approved Guidelines.	/	285.32(c)(1)		/		
AEROBIC TREATMENT UNIT Inspection/Clean Out Port & Risers Provided AEROBIC TREATMENT UNIT Secondary restraint system provided AEROBIC TREATMENT UNIT Riser permanently fastened to lid or cast into tank AEROBIC TREATMENT UNIT Riser cap protected against unauthorized intrusions	/ / / /			/ / / /		
AEROBIC TREATMENT UNIT Chlorinator Properly Installed with Chlorine Tablets in Place.	/			/		
PUMP TANK Is the Pump Tank an approved concrete tank or other acceptable materials & construction PUMP TANK Sampling Port Provided in the Treated Effluent Line PUMP TANK Check Valve and/or Anti- Siphon Device Present When Required PUMP TANK Audible and Visual High Water Alarm Installed on Separate Circuit From Pump						
PUMP TANK Inspection/Clean Out Port & Risers Provided PUMP TANK Secondary restraint system provided PUMP TANK Riser permanently fastened to lid or cast into tank PUMP TANK Riser cap protected against unauthorized intrusions						
PUMP TANK Secondary restraint system provided						
PUMP TANK Electrical Connections in Approved Junction Boxes / Wiring Buried						



**Comal County Environmental Health  
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
40	APPLICATION AREA Distribution Pipe, Fitting, Sprinkler Heads & Valve Covers Color Coded Purple?	/	285.33(d)(2)(G)(iii)(II)285.33(d)(2)(G)(iii)(III)285.33(d)(2)(G)(v) 285.33(d)(2)(G)(iii) 285.33(d)(2)(G)(iv) 285.33(d)(2)(G)(i) 285.33(d)(2)(G)(ii) 285.33(d)(2)(G)(iii)(I)		/		
41	APPLICATION AREA Low Angle Nozzles Used / Pressure is as required APPLICATION AREA Acceptable Area, nothing within 10 ft of sprinkler heads? APPLICATION AREA The Landscape Plan is as Designed	/	285.33(d)(2)(G)(i) 285.33(d)(2)(A) 285.33(d)(2)(F)		/		
42	APPLICATION AREA Area Installed	/		5654 sf	/		
43	PUMP TANK Meets Minimum Reserve Capacity Requirements						
44	PUMP TANK Material Type & Manufacturer						
45	PUMP TANK Type/Size of Pump Installed						



# Comal County Environmental Health OSSF Inspection Sheet

Installer Name: MJ Septic OSSF Installer #: 050023596  
 1st Inspection Date: 1-9-19 2nd Inspection Date: 1-11-19 3rd Inspection Date: \_\_\_\_\_  
 Inspector Name: Connor Inspector Name: Connor Inspector Name: \_\_\_\_\_  
 Permit#: 108031 Address: River Chase 108 Paradise Hills

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
1	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Site and Soil Conditions Consistent with Submitted Planning Materials	/	285.31(a) 285.30(b)(1)(A)(iv) 285.30(b)(1)(A)(v) 285.30(b)(1)(A)(iii) 285.30(b)(1)(A)(ii) 285.30(b)(1)(A)(i)		/		
2	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Setback Distances Meet Minimum Standards	/	285.91(10) 285.30(b)(4) 285.31(d)		/		
3	SEWER PIPE Proper Type Pipe from Structure to Disposal System (Cast Iron, Ductile Iron, Sch. 40, SDR 26)	/	285.32(a)(1)		/		
4	SEWER PIPE Slope from the Sewer to the Tank at least 1/8 Inch Per Foot	/	285.32(a)(3)		/		
5	SEWER PIPE Two Way Sanitary - Type Cleanout Properly Installed (Add. C/O Every 100' &/or 90 degree bends)	/	285.32(a)(5)		/		
6	PRETREATMENT Installed (if required) TCEQ Approved List PRETREATMENT Septic Tank(s) Meet Minimum Requirements		285.32(b)(1)(G) 285.32(b)(1)(E)(iii) 285.32(b)(1)(E)(iv) 285.32(b)(1)(F) 285.32(b)(1)(B) 285.32(b)(1)(C)(i) 285.32(b)(1)(C)(ii) 285.32(b)(1)(D) 285.32(b)(1)(E) 285.32(b)(1)(A) 285.32(b)(1)(E)(ii)(ii) 285.32(b)(1)(E)(i) 285.32(b)(1)(E)(ii)(i)				
7	PRETREATMENT Grease Interceptors if required for commercial		285.34(d)				

tank set level leaking opposite of house mid line  
 patch, reschedule tank check (tank) patched - cover - 1-11-19



# Comal County Environmental Health OSSF Inspection Sheet

Installer Name: MJ Septic OSSF Installer #: 050025596

1st Inspection Date: 1-9-19 2nd Inspection Date: \_\_\_\_\_ 3rd Inspection Date: \_\_\_\_\_

Inspector Name: Connor Inspector Name: \_\_\_\_\_ Inspector Name: \_\_\_\_\_

Permit#: 108031 Address: Riverchase 108 Paradise Hills

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
1	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Site and Soil Conditions Consistent with Submitted Planning Materials	/	285.31(a) 285.30(b)(1)(A)(iv) 285.30(b)(1)(A)(v) 285.30(b)(1)(A)(iii) 285.30(b)(1)(A)(ii) 285.30(b)(1)(A)(i)		/		
2	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Setback Distances Meet Minimum Standards	/	285.91(10) 285.30(b)(4) 285.31(d)		/		
3	SEWER PIPE Proper Type Pipe from Structure to Disposal System (Cast Iron, Ductile Iron, Sch. 40, SDR 26)	/	285.32(a)(1)		/		
4	SEWER PIPE Slope from the Sewer to the Tank at least 1/8 Inch Per Foot	/	285.32(a)(3)		/		
5	SEWER PIPE Two Way Sanitary - Type Cleanout Properly Installed (Add. C/O Every 100' &/or 90 degree bends)	/	285.32(a)(5)		/		
6	PRETREATMENT Installed (if required) TCEQ Approved List PRETREATMENT Septic Tank(s) Meet Minimum Requirements		285.32(b)(1)(G) 285.32(b)(1)(E)(iii) 285.32(b)(1)(E)(iv) 285.32(b)(1)(F) 285.32(b)(1)(B) 285.32(b)(1)(C)(i) 285.32(b)(1)(C)(ii) 285.32(b)(1)(D) 285.32(b)(1)(E) 285.32(b)(1)(A) 285.32(b)(1)(E)(ii)(II) 285.32(b)(1)(E)(i) 285.32(b)(1)(E)(ii)(I)				
7	PRETREATMENT Grease Interceptors if required for commercial		285.34(d)				

*tank set level leaking opposite of house mid line patch, reschedule tank check*



**Comal County Environmental Health  
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
8	SEPTIC TANK Tank(s) Clearly Marked SEPTIC TANK If Single Tank, 2 Compartments Provided with Baffle SEPTIC TANK Inlet Flowline Greater than 3" and " T " Provided on Inlet and Outlet SEPTIC TANK Septic Tank(s) Meet Minimum Requirements		285.32(b)(1)(E) 285.91(2) 285.32(b)(1)(F) 285.32(b)(1)(E)(iii) 285.32(b)(1)(E)(ii)(II) 285.32(b)(1)(E)(ii)(I) 285.32(b)(1)(E)(i) 285.32(b)(1)(D) 285.32(b)(1)(C)(ii) 285.32(b)(1)(C)(i) 285.32(b)(1)(B) 285.32(b)(1)(A) 285.32(b)(1)(E)(iv)				
9	ALL TANKS Installed on 4" Sand Cushion/ Proper Backfill Used	✓	285.32(b)(1)(F) 285.32(b)(1)(G) 285.34(b)		✓		
10	SEPTIC TANK Inspection / Clean Out Port & Risers Provided on Tanks Buried Greater than 12" Sealed and Capped		285.38(d)				
11	SEPTIC TANK Secondary restraint system provided SEPTIC TANK Riser permanently fastened to lid or cast into tank SEPTIC TANK Riser cap protected against unauthorized intrusions		285.38(d) 285.38(e)				
12	SEPTIC TANK Tank Volume Installed						
13	PUMP TANK Volume Installed						
14	AEROBIC TREATMENT UNIT Size Installed	✓			✓		
15	AEROBIC TREATMENT UNIT Manufacturer AEROBIC TREATMENT UNIT Model Number	✓		Pwfl05060 HCSB	✓		
16	DISPOSAL SYSTEM Absorptive		285.33(a)(4) 285.33(a)(1) 285.33(a)(2) 285.33(a)(3)				
17	DISPOSAL SYSTEM Leaching Chamber		285.33(a)(1) 285.33(a)(3) 285.33(a)(4) 285.33(a)(2)				
18	DISPOSAL SYSTEM Evapo-transpirative		285.33(a)(3) 285.33(a)(4) 285.33(a)(1) 285.33(a)(2)				



**Comal County Environmental Health  
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
19	DISPOSAL SYSTEM Drip Irrigation		285.33(a)(1) 285.33(a)(3) 285.33(a)(4) 285.33(a)(2)				
20	DISPOSAL SYSTEM Soil Substitution		285.33(d)(4)				
21	DISPOSAL SYSTEM Pumped Effluent		285.33(a)(4) 285.33(a)(3) 285.33(a)(1)				
22	DISPOSAL SYSTEM Gravelless Pipe		285.33(a)(3) 285.33(a)(2) 285.33(a)(4) 285.33(a)(1)				
23	DISPOSAL SYSTEM Mound		285.33(a)(3) 285.33(a)(1) 285.33(a)(2) 285.33(a)(4)				
24	DISPOSAL SYSTEM Other (describe) (Approved Design)	/	285.33(d)(6) 285.33(c)(4)	<i>aerobic spray</i>	/		
25	DRAINFIELD Absorptive Drainline 3" PVC or 4" PVC						
26	DRAINFIELD Area Installed						
27	DRAINFIELD Level to within 1 inch per 25 feet and within 3 inches over entire excavation		285.33(b)(1)(A)(v)				
28	DRAINFIELD Excavation Width DRAINFIELD Excavation Depth DRAINFIELD Excavation Separation DRAINFIELD Depth of Porous Media DRAINFIELD Type of Porous Media						
29	DRAINFIELD Pipe and Gravel - Geotextile Fabric in Place		285.33(b)(1)(E)				
30	DRAINFIELD Leaching Chambers DRAINFIELD Chambers - Open End Plates w/Splash Plate, Inspection Port & Closed End Plates in Place (per manufacturers spec.)		285.33(c)(2)				
31	LOW PRESSURE DISPOSAL SYSTEM Adequate Trench Length & Width, and Adequate Separation Distance between Trenches		285.33(d)(1)(C)(i)				



**Comal County Environmental Health  
OSSF Inspection Sheet**


No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
32	EFFLUENT DISPOSAL SYSTEM Utilized Only by Single Family Dwelling EFFLUENT DISPOSAL SYSTEM Topographic Slopes < 2.0% EFFLUENT DISPOSAL SYSTEM Adequate Length of Drain Field ( 1000 Linear ft. for 2 bedrooms or Less & an additional 400 ft. for each additional bedroom ) EFFLUENT DISPOSAL SYSTEM Lateral Depth of 18 inches to 3 ft. & Vertical Separation of 1ft on bottom and 2 ft. to restrictive horizon and ground water respectfully EFFLUENT DISPOSAL SYSTEM Lateral Drain Pipe (1.25 - 1.5" dia.) & Pipe Holes ( 3/16 - 1/4" dia. Hole Size ) 5 ft. Apart		285.33(b)(3)(A) 285.33(b)(3)(A) 285.33(b)(3)(B) 285.91(13) 285.33(b)(3)(D) 285.33(b)(3)(F)				
33	AEROBIC TREATMENT UNIT Is Aerobic Unit Installed According to Approved Guidelines.	/	285.32(c)(1)		/		
34	AEROBIC TREATMENT UNIT Inspection/Clean Out Port & Risers Provided AEROBIC TREATMENT UNIT Secondary restraint system provided AEROBIC TREATMENT UNIT Riser permanently fastened to lid or cast into tank AEROBIC TREATMENT UNIT Riser cap protected against unauthorized intrusions	/			/		
35	AEROBIC TREATMENT UNIT Chlorinator Properly Installed with Chlorine Tablets in Place.	/			/		
36	PUMP TANK Is the Pump Tank an approved concrete tank or other acceptable materials & construction PUMP TANK Sampling Port Provided in the Treated Effluent Line PUMP TANK Check Valve and/or Anti- Siphon Device Present When Required PUMP TANK Audible and Visual High Water Alarm Installed on Separate Circuit From Pump						
37	PUMP TANK Inspection/Clean Out Port & Risers Provided PUMP TANK Secondary restraint system provided PUMP TANK Riser permanently fastened to lid or cast into tank PUMP TANK Riser cap protected against unauthorized intrusions						
38	PUMP TANK Secondary restraint system provided						
39	PUMP TANK Electrical Connections in Approved Junction Boxes / Wiring Buried						



**Comal County Environmental Health  
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
40	APPLICATION AREA Distribution Pipe, Fitting, Sprinkler Heads & Valve Covers Color Coded Purple?	/	285.33(d)(2)(G)(iii)(II)285.33(d)(2)(G)(iii)(III)285.33(d)(2)(G)(v) 285.33(d)(2)(G)(iii) 285.33(d)(2)(G)(iv) 285.33(d)(2)(G)(i) 285.33(d)(2)(G)(ii) 285.33(d)(2)(G)(iii)(I)		/		
41	APPLICATION AREA Low Angle Nozzles Used / Pressure is as required APPLICATION AREA Acceptable Area, nothing within 10 ft of sprinkler heads? APPLICATION AREA The Landscape Plan is as Designed	/	285.33(d)(2)(G)(i) 285.33(d)(2)(A) 285.33(d)(2)(F)		/		
42	APPLICATION AREA Area Installed	/		5654 sf	/		
43	PUMP TANK Meets Minimum Reserve Capacity Requirements						
44	PUMP TANK Material Type & Manufacturer						
45	PUMP TANK Type/Size of Pump Installed						



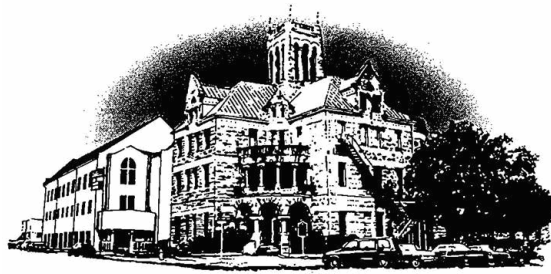

## Comal County

OFFICE OF COMAL COUNTY ENGINEER

### **Permit of Authorization to Construct an On-Site Sewage Facility Permit Valid For One Year From Date Issued**

Permit Number: 108031  
Issued This Date: 09/05/2018  
This permit is hereby given to: Kenneth & Sharon Dearmond

To start construction of a private, on-site sewage facility located at:

108 PARADISE HILLS  
NEW BRAUNFELS, TX 78132

Subdivision: River Chase  
Unit: 8  
Lot: 1347  
Block:  
Acreage:

#### APPROVED MINIMUM SIZES AS PER ATTACHED DESIGN

Type of System: Aerobic  
Surface Irrigation

This permit gives permission for the construction of the above referenced on-site facility to commence. Installation must be completed by an installer holding a valid registration card from the Texas Commission on Environmental Quality (TCEQ). Installation and inspection must comply with current TCEQ and Comal County requirements.

Call (830) 608-2090 to schedule inspections.



\* \* \* COMAL COUNTY OFFICE OF ENVIRONMENTAL HEALTH \* \* \*

APPLICATION FOR PERMIT FOR AUTHORIZATION TO CONSTRUCT AN  
ON-SITE SEWAGE FACILITY AND LICENSE TO OPERATE

Date August 16, 2018

Permit # 108031

Owner Name KENNETH M & SHARON K DEARMOND  
Mailing Address c/o 27552 OLD BLANCO ROAD  
City, State, Zip SAN ANTONIO TEXAS 78260  
Phone# 830-643-0501  
Email theresa@riverhillsbuilders.com

Agent Name GREG W. JOHNSON, P.E.  
Agent Address 170 HOLLOW OAK  
City, State, Zip NEW BRAUNFELS, TX 78132  
Phone # (830) 905-2778  
Email gregjohnsonpe@yahoo.com

All correspondence should be sent to: ☐ Owner ☒ Agent ☐ Both Method: ☐ Mail ☒ Email

Subdivision Name RIVER CHASE Unit/Phase/Section 8 Lot # 1347 Block         
Acreage/Legal         
Street Name/Address 108 PARADISE HILLS City NEW BRAUNFELS Zip 78132

**Type of Development:**

☒ Single Family Residential

Type of Construction (House, Mobile, RV, Etc.) HOUSE

Number of Bedrooms 4

Indicate Sq Ft of Living Area 2552

RECEIVED

AUG 27 2018

COUNTY ENGINEER

☐ Commercial or Institutional Facility

(Planning materials must show adequate land area for doubling the required land needed for treatment units and disposal area)

Type of Facility       

Offices, Factories, Churches, Schools, Parks, Etc. - Indicate Number Of Occupants       

Restaurants, Lounges, Theaters - Indicate Number of Seats       

Hotel, Motel, Hospital, Nursing Home - Indicate Number of Beds       

Travel Trailer/RV Parks - Indicate Number of Spaces       

Miscellaneous       

Estimated Cost of Construction: \$ 350,000 (Structure Only)

Is any portion of the proposed OSSF located in the United States Army Corps of Engineers (USACE) flowage easement?

☐ Yes ☒ No (If yes, owner must provide approval from USACE for proposed OSSF improvements within the USACE flowage easement)

Source of Water ☒ Public ☐ Private Well

Are Water Saving Devices Being Utilized Within the Residence? ☒ Yes ☐ No

By signing this application, I certify that:

- the completed application and all additional information submitted does not contain any false information and does not conceal any material facts.  
- Authorization is hereby given to the permitting authority and designated agents to enter upon the above described property for the purpose of site/soil evaluation and inspection of private sewage facilities.

- I also understand that a permit of authorization to construct will not be issued until the Floodplain Administrator has performed the reviews required by the Comal County Flood Damage Prevention Order.

- I affirmatively consent to the online posting/public release of my e-mail address associated with this permit application, as applicable.

Kenneth M. DeArmond Sharon DeArmond 8/22/18  
Signature of Owner Date



## \* \* \* COMAL COUNTY OFFICE OF ENVIRONMENTAL HEALTH \* \* \*

APPLICATION FOR PERMIT FOR AUTHORIZATION TO CONSTRUCT AN  
ON-SITE SEWAGE FACILITY AND LICENSE TO OPERATEPlanning Materials & Site Evaluation as Required Completed By GREG W. JOHNSON, P.E.System Description PROPRIETARY; AEROBIC TREATMENT AND SURFACE IRRIGATION

## Size of Septic System Required Based on Planning Materials &amp; Soil Evaluation

Tank Size(s) (Gallons) PRO-FLO MODEL 5060, 600 GPD Absorption/Application Area (Sq Ft) 5654Gallons Per Day (As Per TCEQ Table III) 300

(Sites generating more than 5000 gallons per day are required to obtain a permit through TCEQ)

RECEIVED

AUG 27 2018

Is the property located over the Edwards Recharge Zone? ☒ Yes ☐ No

(If yes, the planning materials must be completed by a Registered Sanitarian (R.S.) or Professional Engineer (P.E.))

COUNTY ENGINEER

Is there an existing TCEQ approved WPAP for the property? ☒ Yes ☐ No

(if yes, the R. S. or P. E. shall certify that the OSSF design complies with all provisions of the existing WPAP.)

If there is no existing WPAP, does the proposed development activity require a TCEQ approved WPAP? ☐ Yes ☐ No

(If yes, the R.S. or P. E. shall certify that the OSSF design will comply with all provisions of the proposed WPAP. A Permit to Construct will not be issued for the proposed OSSF until the proposed WPAP has been approved by the appropriate regional office.)

Is the property located over the Edwards Contributing Zone? ☐ Yes ☒ NoIs there an existing TCEQ approval CZP for the property? ☐ Yes ☒ No

(if yes, the P.E. or R.S. shall certify that the OSSF design complies with all provisions of the existing CZP)

If there is no existing CZP, does the proposed development activity require a TCEQ approved CZP? ☐ Yes ☐ No

(if yes, the P.E. or R.S. shall certify that the OSSF design will comply with all provisions of the proposed CZP. A Permit to construct will not be issued for the proposed OSSF until the CZP has been approved by the appropriate regional office.)

Is this property within an incorporated city? ☐ Yes ☒ No

If yes, indicate the city: \_\_\_\_\_



FIRM #2585

By signing this application, I certify that:

- The information provided above is true and correct to the best of my knowledge.
- I affirmatively consent to the online posting/public release of my e-mail address associated with this permit application, as applicable

Signature of Designer

August 22, 2018  
Date



# AFFIDAVIT



201806033560 08/27/2018 11:55:24 AM 1/1

THE COUNTY OF COMAL  
STATE OF TEXAS

## CERTIFICATION OF OSSF REQUIRING MAINTENANCE

According to Texas Commission on Environmental Quality Rules for On-Site Sewage Facilities (OSSFs), this document is filed in the Deed Records of Comal County, Texas.

I

The Texas Health and Safety Code, Chapter 366 authorizes the Texas Commission on Environmental Quality (TCEQ) to regulate on-site sewage facilities (OSSFs). Additionally, the Texas Water Code (TWC), § 5.012 and § 5.013, gives the commission primary responsibility for implementing the laws of the State of Texas relating to water and adopting rules necessary to carry out its powers and duties under the TWC. The commission, under the authority of the TWC and the Texas Health and Safety code, requires owner's to provide notice to the public that certain types of OSSFs are located on specific pieces of property. To achieve this notice, the commission requires a recorded affidavit. Additionally, the owner must provide proof of the recording to the OSSF permitting authority. This recorded affidavit is not a representation or warranty by the commission of the suitability of this OSSF, nor does it constitute any guarantee by the commission that the appropriate OSSF was installed.

II

An OSSF requiring a maintenance contract, according to 30 Texas Administrative Code §285.91(12) will be installed on the property described as (insert legal description):

8 UNIT/PHASE/SECTION BLOCK 1347 LOT RIVER CHASE SUBDIVISION

IF NOT IN SUBDIVISION: ACREAGE SURVEY

The property is owned by (insert owner's full name): KENNETH M. DEARMOND & SHARON K. DEARMOND

This OSSF must be covered by a continuous maintenance contract for the first two years. After the initial two-year service policy, the owner of an aerobic treatment system for a single family residence shall either obtain a maintenance contract within 30 days or maintain the system personally.

Upon sale or transfer of the above-described property, the permit for the OSSF shall be transferred to the buyer or new owner. A copy of the planning materials for the OSSF can be obtained from the Comal County Engineer's Office.

WITNESS BY HAND(S) ON THIS 23rd DAY OF August, 20 18

Kenneth M. DeArmond  
Sharon DeArmond  
Owner(s) signature(s)

Kenneth M. DeArmond  
Sharon DeArmond  
Owner (s) Printed name (s)

Kenneth & Sharon DeArmond  
August 23 20 18

SWORN TO AND SUBSCRIBED BEFORE ME ON THIS 23rd DAY OF


Theresa L. Apostolo  
Notary Public Signature

THIS AREA FOR COMAL COUNTY CLERK RECORDING PURPOSES ONLY

Filed and Recorded  
Official Public Records  
Bobbie Koepf, County Clerk  
Comal County, Texas  
08/27/2018 11:55:24 AM  
TERRI 1 Page(s)  
201806033560



Bobbie Koepf



(Notary Seal Here)



MJ Central Texas Septic, LLC  
DBA MJ Septic  
27552 Old Blanco Road  
San Antonio, Texas 78260  
(210) 875-3625 \* (210) 889-4606  
mjseptic@sabvrr.com (email)  
www.mjseptic.com

Aerobic Installation \* Aerobic Maintenance Contracts  
Real Estate Inspections \* Cleaning/Pumping

Michael J. Long, MP 0001294 Licensed by T.C.E.Q.

RECEIVED

AUG 27 2018

COUNTY ENGINEER

PROPERTY ADDRESS: 108 PARADISE HILLS / RIVER CHASE UNIT 8, LOT 1347

The Texas Commission on Environmental Quality (TCEQ) require all ATU's to be checked and maintained every four months for the life of the unit (some permitting authorities may stipulate this requirement, after the first two years after installation; call your county to inquire). Upon expiration of this contract, MJ Septic will offer a continuation of your maintenance contract to cover labor and routine maintenance/reports. Lab testing, if required, for coliform, TSS, BOD etc. are NOT included in this policy and applicable fees are the owner's responsibility. MJ Septic will inspect and service your ATU once every 4 months for the duration of your 2-year initial contract. For a new single family dwelling, this is the date of installation, required by state guidelines dated June 13, 2001. For an existing single family dwelling, this is the date the notice of approval is issued by your permitting authority. The effective date of this maintenance contract shall be the date the LTO (license to operate) is issued.

MJ Septic will address all major concerns/complaints (excluding weekends & holidays) within 72 hours from the initial point of contact with homeowner(s).

- The annual fee on your contract includes the following: an inspection every four months (three times annually) which include inspecting the mechanical, electrical and other applicable components to ensure proper function. The annual fee does not include any parts, cleaning/pumping, chlorine/bleach (tablets or liquid), additional service calls or additional testing that may be required by any regulating authority. If for any reason, we are unable to obtain access to your property or system to perform a service check, you may be charged a \$75 service call for re-scheduling. It is very important that we have all proper gate codes, combination locks etc. to inspect your system.
- Repairs I: If repairs or replacement of parts is needed during routine inspection, we will try to contact the homeowner for approval if we are able to repair onsite. If we are unable to repair/replace parts onsite, client will be notified via email and/or USPS that repairs/replacement of parts is needed. All MAJOR part replacements come with a 2-year warranty (see notes below). There will be a \$75 warranty credit fee assessed on all parts. Warranted items will only be honored when a valid maintenance contract is in effect with MJ Septic. If the contract has a lapse, ALL WARRANTED items are VOIDED.
- Repairs II: For ATU's under initial installation warranty (2 years from initial installation date) if warranted items are required to be replaced within 30 days of installation, part will be replaced with no fees, after 30 days there will be a \$75 warranty credit fee assessed on all parts. Warranted items will only be honored when a valid maintenance contract is in effect with MJ Septic.
- Additional Service Calls/Charges: If a service call is required by homeowner/renter between regular inspections, a service call fee of \$75 (not including parts and/or cleaning/pumping) will be assessed. We may waive this fee at our discretion. These calls include but are not limited to the following: red light alarms, high water alarms, chlorinator checks, leaky airlines, timer adjustments, spray head adjustments and system power failure.
- Chlorine: The property owner is responsible for maintaining the chlorine supply. TCEQ regulation requires proper chlorination. For liquid chlorinators, homeowners are to add 2-3 gallons of liquid chlorine/bleach per month. (if the chlorinator is completely empty, DO NOT add more than 3 1/2 gallons of liquid chlorine/bleach at a time) For tablet chlorinators, homeowners can purchase Calcium Hypochlorite tablets at their local Home Depot or Lowe's.  
DO NOT USE POOL TABLETS (this can cause a volatile reaction)
- Cleaning/Pumping: The cleaning/pumping of your ATU is not included in your maintenance contract. We always recommend pumping between 10-12" of sludge.  
\*A typical/average household will need to have their system pumped every 2-5 years; this all depends on usage and will vary per household\*
- Transfer of Property/Ownership: The fee of this maintenance contract is non-refundable, however is fully transferrable to the new owner(s). If this policy is sold within the contract period, the signing party is responsible for all repairs unless the new homeowner(s) information is provided before repairs are made and transfer contract is signed (by new homeowner) and returned to us. The new homeowner(s) will be required to meet for a walk-through orientation with one of our technicians during their first visit of their transfer contract. RENTAL HOMES: The PROPERTY OWNER is responsible for all fees associated with this contract. Renters will be required to have a walk-through orientation during their first visit to ensure proper usage, etc.
- Altering the system: Do not allow alteration to any part of the system or sprinkler head locations. Alterations would put the system out of compliance and would cause the property owner additional expense to bring the system back into compliance. Any use of another company to make repairs to the system will violate any warranties and be considered as a breach of this maintenance contract. If client chooses to purchase and use their own parts, MJ Septic will not install nor work on these parts.
- Violations of Warranty: Violations of the warranty include but are not limited to the following: turning off your system at any time, disconnecting the alarm; restricting airflow to the Air Compressor, overloading the system above its daily rated capacity, introducing excessive amounts of harmful matter (including harsh chemicals, cleaners, antibiotics, etc.) into the system or any other harmful usage of your OSSF/ATU. Refusing to Clean/Pump Out Septic when recommended and/or replacing necessary parts as needed. Necessary treatment of ants. Homeowner must keep grass, weeds and plants trimmed and clear of tank access points, control panel, Air Compressor, etc. Moving sprinkler lines without proper documentation, etc. Building over septic tank, lids, etc.
- Terms of Payment: Payment is due in full for the maintenance contract at time of signing. Payment for parts, repairs, cleaning/pumping, service calls, etc. are due prior to or at time of service, unless otherwise specifically noted. If payment is not received within ten (10) business days of service date, a 1.5% finance charge will be assessed per month. If payment is delinquent, your next service check/maintenance contract may be cancelled. If payment is more than 90 days past due, contract will be cancelled and we will send to collections.
- Maintenance Tips/Owner Guide: Please read the attached Maintenance Tips/Owner Guide. Following these easy steps can help prevent unnecessary and avoidable expenses to the homeowner(s). Please initial here that you've received a copy of this document: \_\_\_\_\_ (keep the maintenance tips/guide for your reference)

CIRCLE ONE CHOICE BELOW

Contract Verified (office use only)

1 YEAR	2 YEAR	3 YEAR	2 YEAR INITIAL	Paid in Full at Sign-Up, Non-Refundable; Does Not Include Additional Charges Noted Above.
\$285	\$530	\$675	Included in Installation	Homeowner(s) are NOT required to be present at inspections. They will receive phone call notification the day of service and a door hanger will be left if no one is home. Reports emailed/mailed within a few business days.

**Acceptance of Maintenance Contract:** The above prices, specifications, and conditions are satisfactory and are hereby accepted. MJ Septic is authorized to enter property to perform routine maintenance inspections as agreed. I have read and agree to the maintenance contract guidelines stated above and have also read and agree to comply with the Maintenance Tips/Owner Guide.

Accepted by Signature: Sharon DeArmond Printed Name: Sharon DeArmond Email: dearmonds2@yahoo.com

Phone Numbers: (Home) 817-427-2178 (Mr. Cell) 817-480-3066 (Mrs. Cell) 817-228-4644 (Work) \_\_\_\_\_

Subdivision: RIVER CHASE, U8, LOT 1347 # of Occupants in Home: 3 Gate Codes/Combination Locks, etc. \_\_\_\_\_ Biting Dogs: \_\_\_\_\_  
(MJ Septic will assess a \$75 service fee if we are not notified of gate code changes, biting dogs, etc.)

MJ Central Texas Septic, LLC Authorized Signature: Stephanie E. Perez

Date: \_\_\_\_\_





27552 Old Blanco Road  
San Antonio, Texas 78260  
(210) 875-3625  
[mjseptic@satx.rr.com](mailto:mjseptic@satx.rr.com)  
[www.mjseptic.com](http://www.mjseptic.com)

## Maintenance Tips/Owner Guide for your Aerobic System

RECEIVED

AUG 27 2018

COUNTY ENGINEER

To keep your system functioning properly, regular maintenance is required. No matter how well the system is maintained or how well your aerobic system is designed and household usage, there will be parts that need to be replaced. Some are less expensive (and more common) like diffuser bars (if required, not all brands use diffusers), filters, sprinkler heads, airline, float switches, timers, audio and visual alarms, etc. Some are more expensive like sprinkler pumps, air compressors and septic tank cleanings, etc. With owning an aerobic system, you should expect to have parts replaced and it needing to be cleaned/pumped out. The life span of each part of your system will vary depending upon how many people use your system, how much water is used, what types of food you eat, what medicines are taken, the type of cleaning chemicals being used in the household, what you flush down the commode and of course the regular life expectancy for each functioning part, etc.

Some of the items checked during routine inspections that may need to be replaced or repaired according to their life span. These items include, but are not limited to: air compressor (aerator), a/c filters, filter pads, diffuser bars, sprinkler pumps (irrigation pumps), control panels, electrical circuit boards, float switches, timers, audio alarms, visual alarms, airline, photocell's, toggle switches, wires, junction boxes, risers and/or lids, sprinkler heads, chlorinators, etc.

Below are some recommendations that will help you keep maintenance costs down and will help your aerobic system function properly.

- **RED LIGHT ALARMS:** if your alarm turns on, don't panic (it usually isn't an emergency) Please call our office and schedule a service call with our office. If we are closed (after hours, weekends or holidays), please leave (1) voicemail at (210) 875-3625. You may also send a text to this number. You may email us to leave a request at [mjseptic@satx.rr.com](mailto:mjseptic@satx.rr.com) if you are unable to call or text. We will make a work order for the next available business day. During this time, you as the homeowner need to reduce all non-essential water usage. Don't wait days to report red light alarms!
- **POWER:** In the event of a red-light alarm or at any other time NEVER shut off the power to your system!
- **IRRIGATION SYSTEMS (lawn care) & ALTERATIONS TO THE SYSTEM:** Avoid spraying your irrigation system in the same areas as your septic spray areas. This will cause over saturation to the lawn. Homeowners, landscapers, irrigation and pool companies should NEVER replace or tamper with your aerobic system, including the spray heads. Doing such will void any warranties (if applicable) and may result in additional costs to the homeowner for necessary repairs to bring the system back into compliance. For any changes wanted or needed for swimming pools, decks, sport courts, patios or irrigation systems, it is the homeowner's responsibility to call MJ Septic, LLC at (210) 875-3625 to assist in taking the necessary measures to have alterations made. This usually requires the system to be redesigned by one of our septic designers and re-permitted with your respective county.

\*\* Do not build over any part of the aerobic system (the sprinklers can only be applied to natural vegetation surfaces!)

\*\* Do not landscape over any part of the aerobic system (trees, plants, flowers, etc.)

\*\* Do not allow ants to mound by any part of the aerobic system. Ant killer can be used to treat if mounds occur. (Ants will ruin electrical and void any warranties if applicable)

\*\* Keep all vegetation mowed and trimmed around the entire system, including the spray heads & spray area. If the technician cannot access the system due to overgrown grass, weeds, bushes, etc. there will be a service call charge assessed to return for inspection.

- **CHLORINE (tablets & liquid):** Never store your tablets near water heaters or in your water heater closet. Keep chlorine away from gas and electrical. It is always best to store it in a cool, dry and well ventilated area.  
**\*\* For tablet chlorinators:** use only chlorine that is designed to treat wastewater! Calcium Hypochlorite tablets are available at your local Home Depot or Lowe's. We do not sell them. NEVER USE SWIMMING POOL TABLETS! (mixing pool tablets with wastewater tablets could cause a dangerous volatile reaction. When the chlorinator is completely empty, do not add more than 4-5 tablets at a time to prevent the chlorinator from clogging.  
**\*\* For liquid chlorinators:** you may use liquid chlorine/bleach (same bleach used to wash whites) When the chlorinator is completely empty, add no more than 3 ½ gallons of liquid chlorine bleach at a time. We recommend 2-3 gallons monthly (this will vary depending on how much water is used in the home per month) Do not tamper with chlorinators! This will void any warranties (if applicable).
- An aerobic system should not be treated as city sewer. Economy in the use of water helps prevent overloading the system. Leaky faucets, running commodes, etc. should be guarded against as well. Avoid doing all of your laundry in the same day (try to space to 1-2 loads daily); surges of water entering the system can and will hydraulically overload the system and throw off the balance of bacteria, which will not allow your waste to break down properly.
- Items flushed down commodes and/or poured down the drains DO NOT disappear; they must be treated by the system! Aerobic systems are designed to treat domestic wastewater and most toilet paper (read labels). Things that can harm your system include, but are not limited to are: excessive use of garbage disposal (very light use is okay, only if necessary, otherwise it is strongly recommended against!) fat, grease, oils, too many cleaners, too much fabric softener, too much bleach, cigarette butts, baby wipes, facial wipes, cleaning wipes, any type of wipes, feminine products, paper towels, condoms, q-tips, paint, paint thinners, varnishes, drain cleaners, automatic toilet bowl cleaners, hair combings, pet hair, coffee grounds, fruit, fruit peels, fruit juices, cola, wine, salad oil, sugars, dental floss, any type of diapers, kitty litter, gauze bandages, unused medications, etc. Items such as these even though they may say "flushable" or "septic safe" can cause the homeowner unnecessary and avoidable expenses for repairs to the system, as well as additional expenses when cleaning out the tanks.
- We take sludge level readings at every routine inspection (every four months) unless the system has been shut off/power failure. We always recommend cleaning/pumping of the system when levels reach 10-12" of sludge. \*A typical/average household will need to have their system cleaned/pump every 2-5 years; this all depends on usage and WILL VARY per HOUSEHOLD! This fee is NOT included in your annual maintenance contract agreement.



Greg W. Johnson, P.E.  
170 Hollow Oak  
New Braunfels, Texas 78132  
830/905-2778

August 22, 2018

RECEIVED  
AUG 27 2018  
COUNTY ENGINEER

Comal County Office of Environmental Health  
195 David Jonas Drive  
New Braunfels, Texas 78132-3760


RE- SEPTIC DESIGN  
108 PARADISE HILLS  
RIVER CHASE, UNIT 8, LOT 1347  
NEW BRAUNFELS, TX 78132  
DEARMOND RESIDENCE

Ms. Brenda Ritzen/Sandra Hernandez,

The referenced property is located within the Edwards Aquifer Recharge Zone. This OSSF design will comply with requirements in the WPAP.

Temporary erosion and sedimentation controls should be utilized as necessary prior to construction. If any sensitive feature (caves, solution cavities, sink holes, etc.) is discovered during construction, activities must be suspended immediately and the applicant or his agent must immediately notify the TCEQ Regional Office. After that operations can only proceed after the Executive Director approves required additional engineered impact plans.

Designed in accordance with Chapter 285, Subchapter D, §285.40, 285.41, & 285.42, Texas Commission on Environmental Quality (Effective December 29, 2016).

 08/22/18  
\_\_\_\_\_  
Greg W. Johnson, P.E. No. 67587 / F#2585  
170 Hollow Oak  
New Braunfels, Texas 78132 - 830/905-2778





# ON-SITE SEWERAGE FACILITY SOIL EVALUATION REPORT INFORMATION

Date Soil Survey Performed: August 21, 2018

Site Location: RIVER CHASE, UNIT 8, LOT 1347

Proposed Excavation Depth: N/A

**Requirements:**


At least two soil excavations must be performed on the site, at opposite ends of the proposed disposal area.  
Locations of soil boring or dug pits must be shown on the site drawing.  
For subsurface disposal, soil evaluations must be performed to a depth of at least two feet below the proposed excavation depth. For surface disposal, the surface horizon must be evaluated.  
Describe each soil horizon and identify any restrictive features on the form. Indicate depths where features appear.

RECEIVED  
AUG 27 2018  
COUNTY ENGINEER

SOIL BORING NUMBER <u>          </u> SURFACE EVALUATION <u>          </u>						
Depth (Feet)	Texture Class	Soil Texture	Gravel Analysis	Drainage (Mottles/ Water Table)	Restrictive Horizon	Observations
0	IV	CLAY	N/A	NONE OBSERVED	LIMESTONE @ 4"	BROWN
1						
2						
3						
4						
5						

SOIL BORING NUMBER <u>          </u> SURFACE EVALUATION <u>          </u>						
Depth (Feet)	Texture Class	Soil Texture	Gravel Analysis	Drainage (Mottles/ Water Table)	Restrictive Horizon	Observations
0	SAME		AS		ABOVE	
1						
2						
3						
4						
5						

I certify that the findings of this report are based on my field observations and are accurate to the best of my ability.

  
\_\_\_\_\_  
Greg W. Johnson, P.E. 67587-F2585, S.E. 11561

08/21/18  
\_\_\_\_\_  
Date



# OSSF SOIL EVALUATION REPORT INFORMATION

Date: August 22, 2018

## Applicant Information:

Name: KENNETH M. & SHARON K. DeARMOND  
Address: c/o 27552 OLD BLANCO ROAD  
City: SAN ANTONIO State: TEXAS  
Zip Code: 78260 Phone: (830) 643-0501

## Site Evaluator Information:

Name: Greg W. Johnson, P.E., R.S., S.E. 11561  
Address: 170 Hollow Oak  
City: New Braunfels State: Texas  
Zip Code: 78132 Phone & Fax (830)905-2778

## Property Location:

Lot 1347 Unit 8 Blk      Subd. RIVER CHASE  
Street Address: 108 PARADISE HILLS  
City: NEW BRAUNFELS Zip Code: 78132  
Additional Info.:     

## Installer Information:

Name:       
Company:       
Address:       
City:      State:       
Zip Code:      Phone     

**Topography:** Slope within proposed disposal area: 10 %  
Presence of 100 yr. Flood Zone: YES      NO X  
Existing or proposed water well in nearby area: YES      NO X  
Presence of adjacent ponds, streams, water impoundments: YES      NO X  
Presence of upper water shed: YES      NO X  
Organized sewage service available to lot: YES      NO X

RECEIVED

AUG 27 2018

## Design Calculations for Aerobic Treatment with Spray Irrigation:

### Commercial

Q =      GPD

Residential Water conserving fixtures to be utilized? Yes X No     

Number of Bedrooms the septic system is sized for: 4 Total sq. ft. living area 2552

Q gal/day = (Bedrooms + 1) \* 75 GPD - (20% reduction for water conserving fixtures)

Q = (4 + 1) \* 75 - (20%) = 300

Trash Tank Size 397 Gal.

TCEQ Approved Aerobic Plant Size 600 G.P.D.

Req'd Application Area = Q/Ri = 300 / 0.064 = 4688 sq. ft.

Application Area Utilized = 5654 sq. ft.

Pump Requirement 12 Gpm @ 41 Psi (Redjacket 0.5 HP 18 G.P.M. series or equivalent)

Dosing Cycle:      ON DEMAND or X TIMED TO DOSE IN PREDAWN HOURS

Pump Tank Size = 768 Gal. 14.4 Gal/inch.

Reserve Requirement = 100 Gal. 1/3 day flow.

Alarms: Audible & Visual High Water Alarm & Visual Air Pump malfunction

With Chlorinator NSF/TCEQ APPROVED

SCH-40 or SDR-26 3" or 4" sewer line to tank


Two way cleanout

Pop-up rotary sprinkler heads w/ purple non-potable lids

1" Sch-40 PVC discharge manifold

APPLICATION AREA SHOULD BE SEEDED AND MAINTAINED WITH VEGETATION.

I HAVE PERFORMED A THOROUGH INVESTIGATION BEING A REGISTERED PROFESSIONAL ENGINEER AND SITE EVALUATOR IN ACCORDANCE WITH CHAPTER 285, SUBCHAPTER D, §285.30, & §285.40 (REGARDING RECHARGE FEATURES), TEXAS COMMISSION OF ENVIRONMENTAL QUALITY (EFFECTIVE DECEMBER 29, 2016)



GREG W. JOHNSON, P.E. F#002585 - S.E. 11561


08/22/18  
DATE



FIRM #2585



9:15 am, Jan 22, 2019

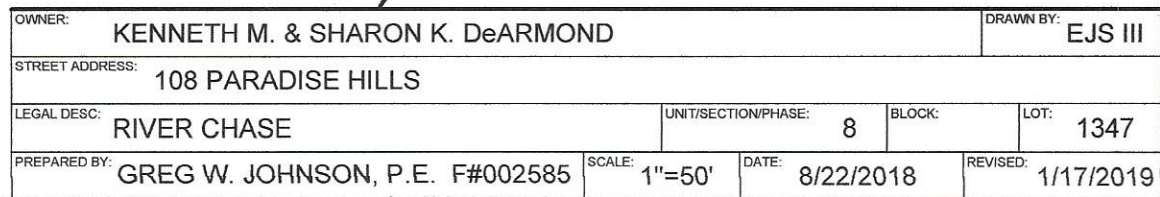







RECEIVED  
AUG 27 2018  
COUNTY ENGINEER

### TANK NOTES:



Tanks must be set to allow a minimum of 1/8" per foot fall from the residence.

Tightlines to the tank shall be SCH-40 PVC.

A two way sanitary tee is required between residence and tank.

A minimum of 4" of sand, sandy loam, clay loam free of rock shall be placed under and around tanks

ALL WIRING MUST BE IN COMPLIANCE WITH  
THE MOST RECENT NATIONAL ELECTRIC CODE

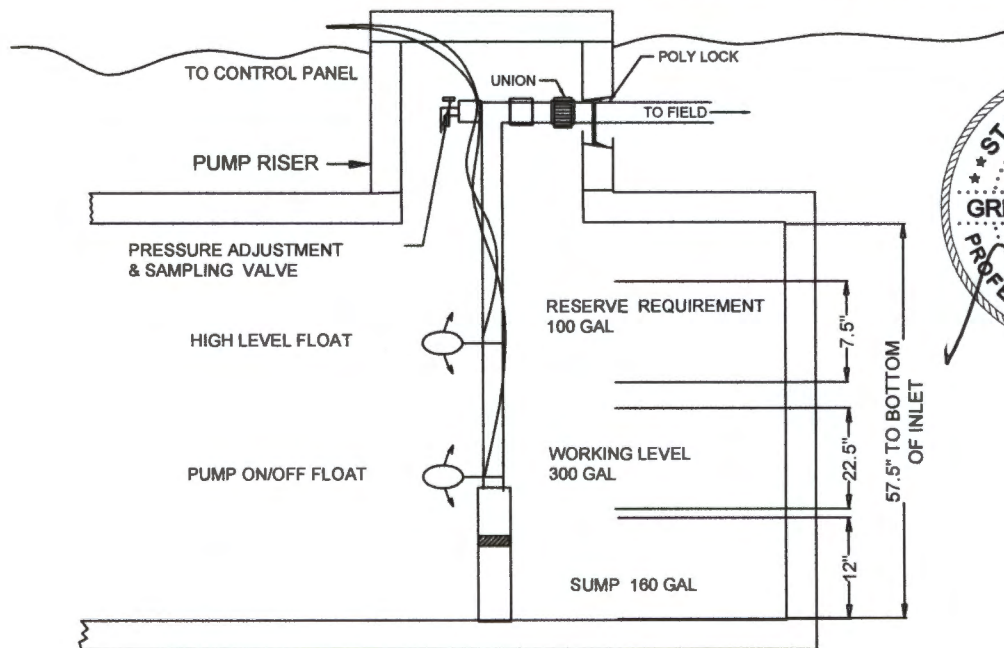


F-2585

08/22/18

**TYPICAL PUMP TANK CONFIGURATION  
PRO-FLO 768 GAL PUMP TANK**









**VOID**

AUG 27 2018

COUNTY ENGINEER

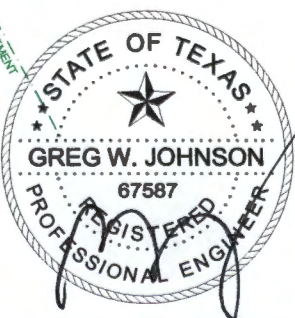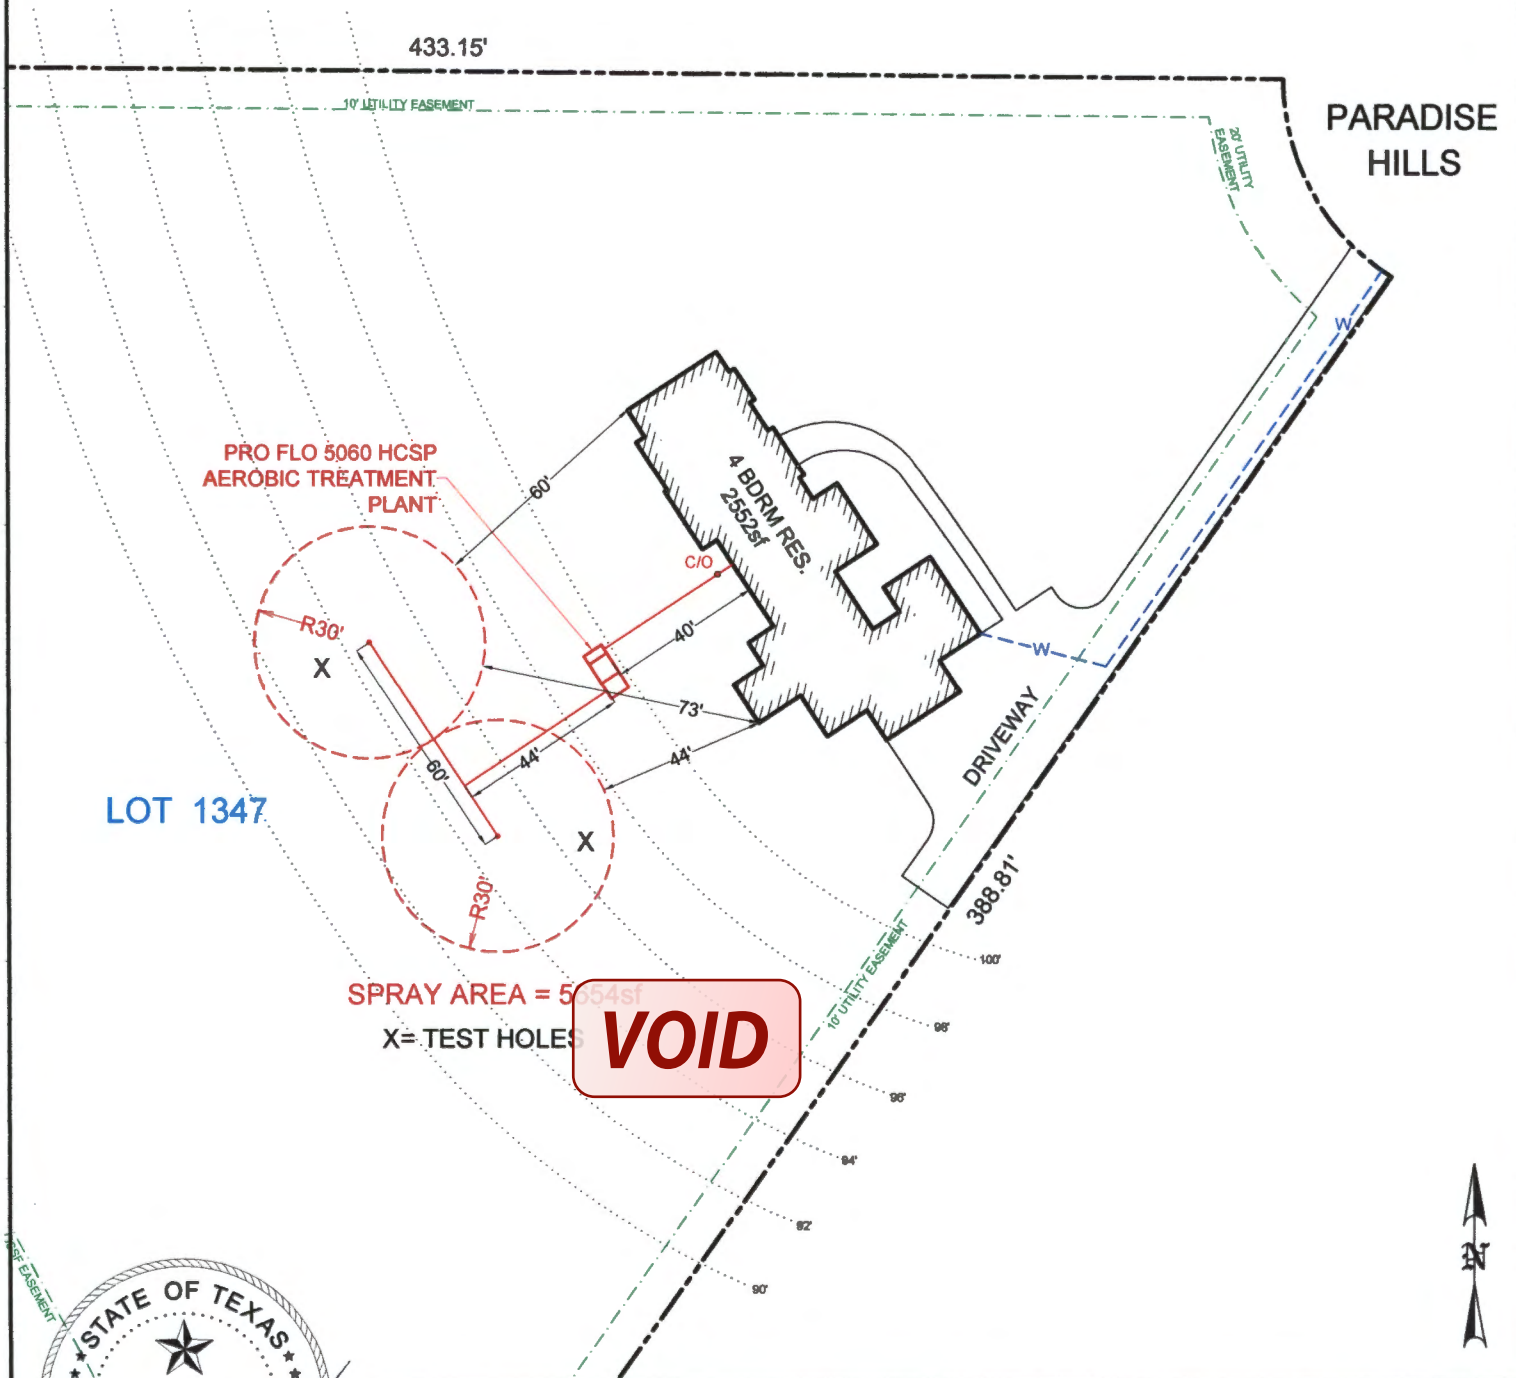


OWNER: KENNETH M. & SHARON K. DeARMOND		DRAWN BY: EJS III	
STREET ADDRESS: 108 PARADISE HILLS			
LEGAL DESC: RIVER CHASE		UNIT/SECTION/PHASE: 8	BLOCK: LOT: 1347
PREPARED BY: GREG W. JOHNSON, P.E. F#002585	SCALE: 1"=50'	DATE: 8/22/2018	REVISED:



**VOID**

RECEIVED  
AUG 27 2018  
COUNTY ENGINEER

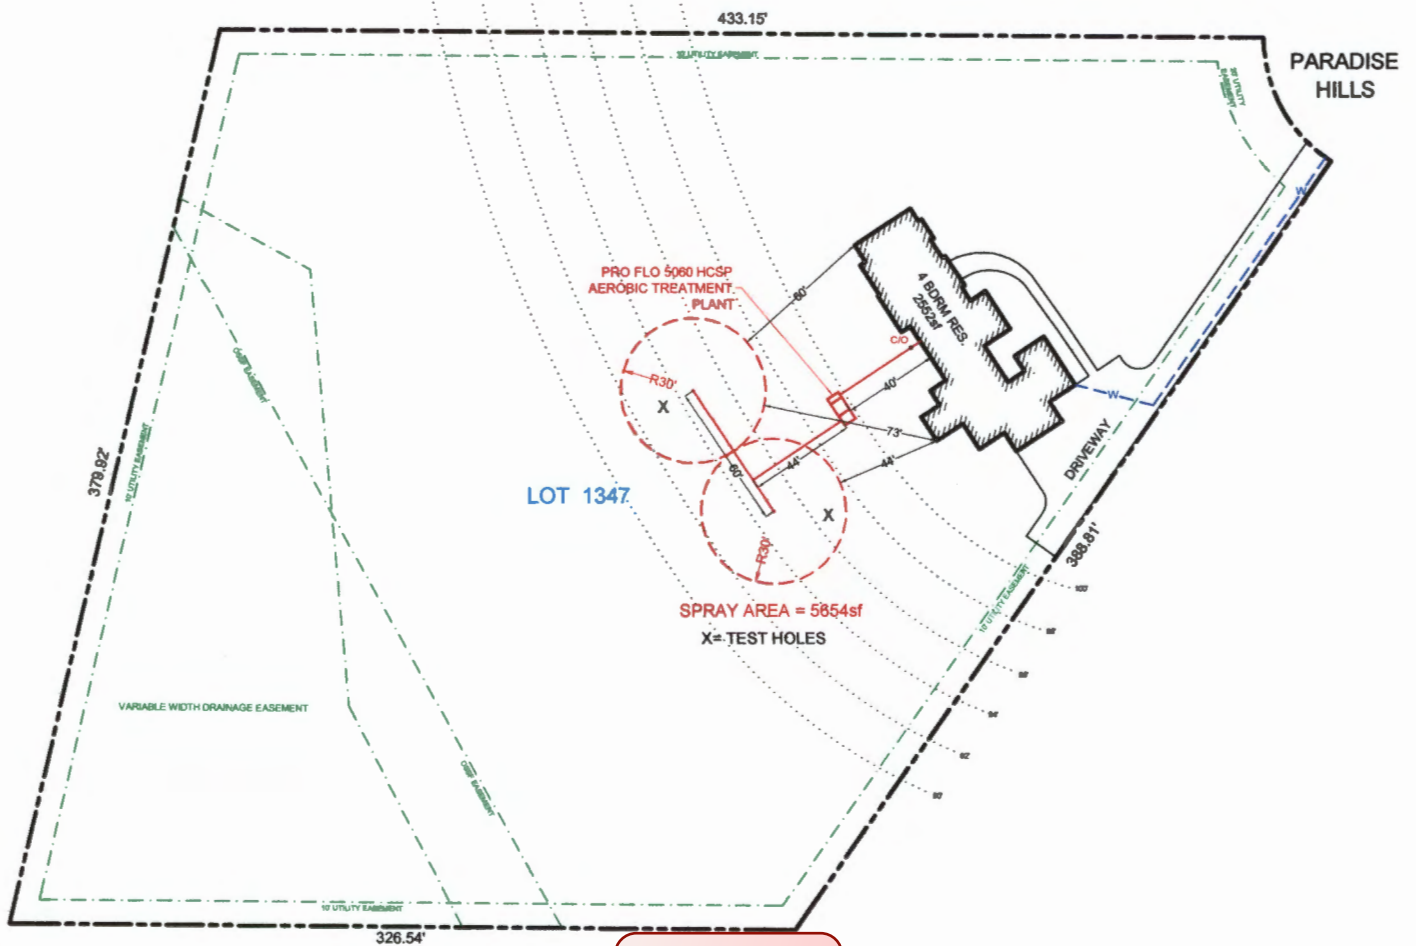

**VOID**



OWNER: KENNETH M. & SHARON K. DeARMOND		DRAWN BY: EJS III	
STREET ADDRESS: 108 PARADISE HILLS			
LEGAL DESC: RIVER CHASE	UNIT/SECTION/PHASE: 8	BLOCK:	LOT: 1347
PREPARED BY: GREG W. JOHNSON, P.E. F#002585	SCALE: 1"=80'	DATE: 8/22/2018	REVISED:



**GENERAL WARRANTY DEED**

**"NOTICE OF CONFIDENTIALITY RIGHTS: IF YOU ARE A NATURAL PERSON, YOU MAY REMOVE OR STRIKE ANY OR ALL OF THE FOLLOWING INFORMATION FROM THIS INSTRUMENT BEFORE IT IS FILED FOR RECORD IN THE PUBLIC RECORDS: YOUR SOCIAL SECURITY NUMBER OR YOUR DRIVERS LICENSE NUMBER."**

THE STATE OF TEXAS

§  
§  
§

4000141800642  
KNOW ALL MEN BY THESE PRESENTS:

COUNTY OF COMAL

THAT, **GREGORY M. DeARMOND aka Gregory Dearmond** ("Grantor") for and in consideration of the sum of TEN AND NO/100 DOLLARS (\$10.00) to the undersigned paid by the Grantees herein named, the receipt of which is hereby acknowledged, has GRANTED, SOLD and CONVEYED, and by these presents does GRANT, SELL and CONVEY, subject to the terms and conditions listed hereinafter, unto **KENNETH M. DeARMOND and SHARON K. DeARMOND** ("Grantees"), a sixty-six point six hundred sixty-six percent (66.666%) undivided interest in the following described real property situated in Comal County, Texas, together with all improvements thereon, to-wit:

**Lot 1347, River Chase Unit Eight, Comal County, Texas, according to plat thereof recorded in Volume 15, Page 177, Map and Plat Records of Comal County, Texas;**

subject to all the restrictions, covenants and conditions, easements, mineral interests and rights-of-way either apparent from a current survey or of record in the Office of the County Clerk of Comal County, Texas, and to taxes for 2018 and all subsequent years, which are assumed by Grantees.

TO HAVE AND TO HOLD said above described premises, together with all and singular the rights and appurtenances thereto in anywise belonging unto said Grantees, their respective heirs, executors, administrators, successors and assigns forever; and Grantor hereby binds himself and his heirs, executors, administrators, successors and assigns, to WARRANT AND FOREVER DEFEND all and singular the said premises unto said Grantees, their respective heirs, executors, administrators, successors and assigns, against every person lawfully claiming or to claim the same or any part thereof.

EXECUTED this the 6 day of July, 2018.

  
GREGORY M. DeARMOND aka Gregory Dearmond


STATE OF TEXAS


§  
§  
§

COUNTY OF COMAL

BEFORE me Shanna L. Hicks, on this day personally appeared Gregory M. DeArmond aka Gregory Dearmond, known to me (or proved to me on the oath of valid ID or through valid ID), to be the person whose name is subscribed to the foregoing instrument and acknowledged to me that he executed the same for the purposes and consideration therein expressed.

Given under my hand and seal of office this 6 day of July, 2018.

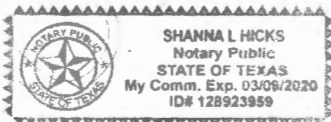

  
NOTARY PUBLIC in and for the State of Texas

**Grantees' Mailing Address:**

545 Creekside Forest  
New Braunfels, Texas 78130

**After Recording Return To:**

Moody National Bank  
Attn: Loan Operations  
1100 Bay Area Blvd.  
Houston, Texas 77058

Filed and Recorded  
Official Public Records  
Bobbie Koepf, County Clerk  
Comal County, Texas  
07/17/2018 02:32:34 PM  
TERRI 1 Pages(s)  
201806028034



*Bobbie Koepf*



**MJ Septic, LLC**  
27552 Old Blanco Road  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com    mjseptic@mjseptic.com

To: **Kenneth & Sharon Dearmond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Printed: 5/17/2019  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Agency: Comal County Environmental Health  
County: Comal                      Sub: River Chase  
Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP  
Treatment Type: Aerobic  
Disposal: Surface Application

Customer ID: 4589

Contract Dates: 1/30/2019 - 1/30/2021

Scheduled Date: 5/30/2019

Inspection 1 of 6

**Service Type: Scheduled Inspection**

**Visit Date: 5/15/2019**

Time In: 3:26pm

**Method: Other**

**Technician: Manuel Guerrero**

**Maint. Provider: Michael J. Long**

**Aerators: Operational**

**Filters: Operational**

**Irrigation Pumps: Operational**

**Disinfection Device: Operational**

**Chlorine Supply: Operational**

**Chlorine Residual: 0.1mg/L**

**Sludge Levels**

**For Tank 1: 0-1**

☒ This counts as a type of "Scheduled Inspection"

**Entered By: Adela Shapiro**

☒ Copy emailed to Customer

Customer Emailed: 5/16/2019

☒ Copy emailed to the Agency

Agency Emailed: 5/17/2019

**Tank Lid / Riser: Secured**

**Electric Circuits: Operational**

**Distribution System: Operational**

**Sprayfield Veg: Operational**

**Odor: Good**

**Alarm: Operational**

**Comments**

- Technician Secured the Tank Lid and/or Riser prior to leaving location.
- \*Septic tank cleaning is recommended between 10"-12" of sludge\*
- \*This inspection report is not valid for any real estate transactions\* - Copy emailed to the customer on 5/16/2019.

☒ **Service Completed**

Insp ID #: 25608

**Provider: Michael J. Long**

License #: MP0001294

Expires: 8/31/2019

**MJ Septic, LLC**  
27552 Old Blanco Road  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com mjseptic@mjseptic.com

To: **Kenneth & Sharon Dearmond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Printed: 1/24/2020  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Agency: Comal County Environmental Health

County: Comal

Sub: River Chase

Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP

Treatment Type: Aerobic

Disposal: Surface Application

Customer ID: 4589

Contract Dates: 1/30/2019 - 1/30/2021

Scheduled Date: 1/30/2020

Inspection 3 of 6

**Service Type: Scheduled Inspection**

**Visit Date: 1/23/2020**

Time In: 1:50pm

**Method: Other**

**Technician: Manuel Guerrero**

**Maint. Provider: Michael J. Long**

**Aerators: Operational**

**Filters: Operational**

**Irrigation Pumps: Operational**

**Disinfection Device: Operational**

**Chlorine Supply: Operational**

**Chlorine Residual: 0mg/L**

**Sludge Levels**

**For Tank 1: 4**

**Tank Lid / Riser: Secured**

**Electric Circuits: Operational**

**Distribution System: Operational**

**Sprayfield Veg: Operational**

**Alarm: Operational**

**Odor: Good**

☒ This counts as a type of "Scheduled Inspection"

**Entered By: Koiana Madison**

☒ Copy emailed to Customer

Customer Emailed: 1/24/2020

☒ Copy emailed to the Agency

Agency Emailed: 1/24/2020

☒ **Problem  
Indicated**

☒ **Service Completed**

**Comments**

- Technician Secured the Tank Lid and/or Riser prior to leaving location.
- \*Septic tank cleaning is recommended between 10 and 12 inches of sludge in the pump tank (tank 1) or unless otherwise recommended by technician for other reasons such as full trash tank, etc.\*
- \*This inspection report is not valid for any real estate transactions\*
- Technician noted that there was a problem or issue with this Scheduled Inspection.
- Attention: Chlorine Residual reading was ZERO. Please add Chlorine to your system Monthly as Required
- Copy emailed to the customer on 1/24/2020.

Insp ID #:29774

**Provider: Michael J. Long**

License #: MP0001294

Expires: 8/31/2022



**MJ Septic, LLC**  
27552 Old Blanco Road  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com mjseptic@mjseptic.com

To: **Kenneth & Sharon Dearmond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Printed: 9/25/2020  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Customer ID: 4589

Agency: Comal County Environmental Health

Contract Dates: 1/30/2019 - 1/30/2021

County: Comal

Sub: River Chase

Scheduled Date: 9/30/2020

Inspection 5 of 6

Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP

Treatment Type: Aerobic

Disposal: Surface Application

**Service Type: Scheduled Inspection**

☒ This counts as a type of "Scheduled Inspection"

**Visit Date: 9/24/2020**

Time In: 2:30 PM

**Entered By: Hannah Graham**

**Method: Other**

☒ Copy emailed to Customer

Customer Emailed: 9/24/2020

**Technician: Manuel Guerrero**

☒ Copy emailed to the Agency

Agency Emailed: 9/25/2020

**Maint. Provider: Michael J. Long**

**Aerators: Operational**

**Sludge Levels**

**Filters: Operational**

**For Tank 1: 12**

**Irrigation Pumps: Operational**

**Disinfection Device: Operational**

**Chlorine Supply: Operational**

☒ **Pumping Needed**

**Chlorine Residual: 0.1mg/L**

**Tank Lid / Riser: Secured**

☒ **Problem  
Indicated**

**Electric Circuits: Operational**

**Distribution System: Operational**

**Sprayfield Veg: Operational**

**Odor: Good**

**Alarm: Operational**

☒ **Service Completed**

**Comments**

- Technician Secured the Tank Lid and/or Riser prior to leaving location.
- \*Septic tank cleaning is recommended between 10 and 12 inches of sludge in the pump tank (tank 1) or unless otherwise recommended by technician for other reasons such as full trash tank, etc.\*
- \*This inspection report is not valid for any real estate transactions\*
- Technician noted that there was a problem or issue with this Scheduled Inspection.
- Tank needs Pumping. - Copy emailed to the customer on 9/24/2020.

Insp ID #:34019

**Provider: Michael J. Long**

License Info: MP0001294 Expires: 8/31/2022

**MJ Septic, LLC**  
27552 Old Blanco Road  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com    mjseptic@mjseptic.com

**To: Kenneth & Sharon Dearmond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Printed: 6/4/2020  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Agency: Comal County Environmental Health

County: Comal

Sub: River Chase

Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP

Treatment Type: Aerobic

Disposal: Surface Application

Customer ID: 4589

Contract Dates: 1/30/2019 - 1/30/2021

Scheduled Date: 5/30/2020

Inspection 4 of 6

**Service Type: Scheduled Inspection**

**Visit Date: 5/26/2020**

Time In: 4:00pm

**Method: Other**

**Technician: Manuel Guerrero**

**Maint. Provider: Michael J. Long**

**Aerators: Operational**

**Filters: Operational**

**Irrigation Pumps: Operational**

**Disinfection Device: Operational**

**Chlorine Supply: Operational**

**Chlorine Residual: 0.1mg/L**

**Sludge Levels**

**For Tank 1: 5**

☒ This counts as a type of "Scheduled Inspection"

**Entered By: Adela Shapiro**

☒ Copy emailed to Customer

Customer Emailed: 5/26/2020

☒ Copy emailed to the Agency

Agency Emailed: 6/4/2020

**Tank Lid / Riser: Secured**

**Electric Circuits: Operational**

**Distribution System: Operational**

**Sprayfield Veg: Operational**

**Odor: Good**

**Alarm: Operational**

☒ **Service Completed**

**Comments**

- Technician Secured the Tank Lid and/or Riser prior to leaving location.
- \*Septic tank cleaning is recommended between 10 and 12 inches of sludge in the pump tank (tank 1) or unless otherwise recommended by technician for other reasons such as full trash tank, etc.\*
- \*This inspection report is not valid for any real estate transactions\* - Copy emailed to the customer on 5/26/2020.

Insp ID #:31950

**Provider: Michael J. Long**

License Info: MP0001294 Expires: 8/31/2022



## MJ Septic, LLC

27552 Old Blanco Road  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com mjseptic@mjseptic.com

To: **Kenneth & Sharon Dearmond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Customer ID

4589

Contract Period

Start Date: 1/30/2021

End Date: 1/30/2022

Email: dearmonds2@yahoo.com

Permit #: 108031

Phone: (817) 480-3066 Subdivision: River Chase

Site: 108 Paradise Hills, New Braunfels, TX 78132

County: Comal

Installer: MJ Central Texas Septic, LLC

Agency: Comal County Environmental Health

Mfg/Brand: Pro Flo Aerobic Systems, LP-Pro Flo Aerobic Systems, LP-

MJ Septic, LLC

3 visits per year - one every 4 months

600 gallons per day

The Texas Commission on Environmental Quality (TCEQ) require all ATU's to be checked and maintained every four months for the life of the unit (*some permitting authorities may stipulate this requirement, after the first two years after installation; call your county to inquire*). Upon expiration of this contract, MJ Septic will offer a continuation of your maintenance contract to cover labor and routine maintenance/reports. Lab testing, if required, for coliform, TSS, BOD etc. are NOT included in this policy and applicable fees are the owner's responsibility. MJ Septic will inspect and service your ATU once every 4 months for the duration of your 2-year initial contract. For a new single-family dwelling, this is the date of installation, required by state guidelines dated June 13, 2001. For an existing single-family dwelling, this is the date the notice of approval is issued by your permitting authority. The effective date of this maintenance contract shall be the date the LTO (license to operate) is issued.

• **ROUTINE INSPECTIONS:** an inspection every four months (three times annually) which includes inspecting/servicing the mechanical, electrical and other applicable components to ensure proper function. The annual fee does not include any parts, cleaning/pumping, chlorine/bleach (tablets or liquid), additional service calls or additional testing that may be required by any regulating authority. If for any reason, we are unable to obtain access to your property or system to perform a service check, you may be charged a \$75 service call for re-scheduling. It is very important that we always have full access to your system, including all gate codes, combination locks etc. to inspect your system.

• **SERVICE CALLS:** If a service call is required by homeowner/renter between regular inspections, a service call fee of \$75 (not including parts and/or cleaning/pumping) will be assessed. We may waive this fee at our discretion. These calls include but are not limited to the following: red light alarms, high water alarms, chlorinator checks, disconnected airlines, timer adjustments, spray head adjustments and system power failure. *MJ Septic will address all major concerns/complaints (excluding weekends & holidays) within 72 hours from the initial point of contact with homeowner(s). Please note our normal office hours are Monday - Friday 8am to 5pm (techs work extended hours)*

• **REPAIRS:** If repairs or replacement of parts are needed during routine inspection, we will attempt to contact the homeowner for approval to make onsite repairs. If we are unable to repair/replace parts onsite, client will be notified via email and/or USPS that repairs/replacement of parts is needed. All MAJOR part replacements come with a 2-year warranty (see notes below). There will be a \$75 warranty credit fee assessed on all parts. Warranted items will only be honored when a valid maintenance contract is in effect with MJ Septic. If the contract has a lapse in time, ALL WARRANTED items are VOIDED.

For ATU's under initial installation warranty (2 years from initial installation date) if warranted items are required to be replaced within 30 days of installation, part will be replaced with no fees, after 30 days there will be a \$75 warranty credit fee assessed on all parts. Warranted items will only be honored when a valid maintenance contract is in place with MJ Septic.

{ PAGE 1 - RETURN TO MJ SEPTIC }

PROPERTY ADDRESS: \_\_\_\_\_

HOMEOWNER NAME: \_\_\_\_\_

• **CLEANING/PUMPING:** The cleaning/pumping of your ATU is not included in your maintenance contract. We always recommend pumping between 10-12" of sludge. We determine this by gathering 3-4 different readings out of your pump tank with a sludge judge. A few other factors that *may* determine pumping is necessary even if your sludge reading is less than 10-12". *\*A typical/average household will need to have their system pumped every 2-5 years; this all depends on usage and will vary per household\**

• **CHLORINATION:** *The property owner is responsible for maintaining their own chlorine supply.* TCEQ regulation requires proper chlorination. For liquid chlorinators, homeowners are to add 2-3 gallons of liquid chlorine/bleach per month. (if the chlorinator is completely empty, DO NOT add more than 3 ½-4 gallons of liquid chlorine/bleach at a time) For tablet chlorinators, homeowners can purchase Calcium Hypochlorite tablets typically purchased at a local Home Depot or Lowe's. **DO NOT USE POOL TABLETS** (this can cause a dangerous volatile chemical reaction)

• **TRANSFER OF MAINTENANCE CONTRACT/PROPERTY OWNERSHIP:** The fee of this maintenance contract is non-refundable, however is fully transferrable to the new owner(s). If this policy is sold within the contract period, the signing party is responsible for all repairs unless the new homeowner(s) information is provided before repairs are made and transfer contract is signed (by new homeowner) and returned to us. The new homeowner(s) will be required to meet for a walk-through orientation with one of our technicians during their first visit of their transfer contract. Only one walk through orientation is included, shall the homeowner need an additional walk through, there will be a \$75 service call fee.

**RENTAL HOMES:** *The PROPERTY OWNER is responsible for all fees associated with this contract. Renters will be required to have a walk-through orientation during their first visit to ensure proper usage, etc.*

• **ALTERATIONS/MODIFICATIONS TO THE SYSTEM:** Do not allow alteration to any part of the system or sprinkler head locations. Alterations would put the system out of county/code compliance and would cause the property owner additional expense to bring the system back into compliance. Any use of another company to make repairs to the system will void any warranties and be considered as a breach of this maintenance contract. If client chooses to purchase and use their own parts, MJ Septic will not install nor work on these parts. Adding pools, decks, sport courts, outdoor kitchens, sheds etc. without proper septic design and county permitting is not acceptable. You must have a septic designer redesign your septic system and have permitting authority's approval prior to any additions being made. MJ Septic is not liable for any fines you may incur from illegal modifications.

• **WARRANTY VIOLATIONS:** Violations of the warranty include but are not limited to the following: turning off your system at any time, disconnecting the alarm; restricting airflow to the air compressor, overloading the system above its daily rated capacity, introducing excessive amounts of harmful matter (including harsh chemicals, cleaners, antibiotics, etc.) into the system or any other harmful usage of your OSSF/ATU. Refusing to clean/pump out septic when recommended and/or replacing necessary parts as needed. Necessary treatment of ants. Homeowner must keep grass, weeds and plants trimmed and clear of tank access points, control panel, air compressor, etc. Moving sprinkler lines without proper documentation, etc. Building over septic tank, lids, etc. Adding pools, decks, sport courts, outdoor kitchens, sheds etc without proper septic design and county permitting is not acceptable. You must have a septic designer redesign your septic system and have permitting authority's approval prior to any additions being made. MJ Septic is not liable for any fines you may incur from illegal modifications.

{ PAGE 2 - RETURN TO MJ SEPTIC }

PROPERTY ADDRESS: \_\_\_\_\_



HOMEOWNER NAME: \_\_\_\_\_

**TERMS OF PAYMENT:** *Payment is due in full for the maintenance contract at time of signing. A credit card will be required at time of booking any service for parts, repairs, cleaning/pumping, service calls, red lights, etc. unless otherwise specifically noted. MJ will not perform any repairs or pumping unless we have a credit card on file. MJ Septic no longer accepts payment onsite, whether it be a check or credit card and we no longer offer billing/invoicing for future payments; this is a strict office policy, no exceptions.*

Please circle one of the following options below:      **CALLED IN Credit Card Payment:** \_\_\_\_\_

\$285 - (1) One Year Initial/Renewal      \$530 - (2) Two Year Initial/Renewal

\$675 - (3) Three Year Initial/Renewal      **Two Year New Installation, Included with Installation**

Homeowner(s) are NOT required to be present at inspections. You will receive a phone call/text notification, the evening prior, if noted in your account or the day of service if not noted.

If client does not answer that evening a voicemail will be left, this is your courtesy call!

A door hanger will be left if no one is home. Inspection reports emailed/mailed within a few business days to the email/mailling address of record.

• **MAINTENANCE TIPS/SEPTIC GUIDE:** *\*Please keep the attached Maintenance Tips & Owner's Septic Guide for future reference\* Please note our business hours are Monday - Friday 8am to 5pm, should you have an emergency during non-business hours, please look this over and follow the necessary steps until you can reach us during normal business hours!*

• *If you are unable to reach us during business or non-business hours, you can leave a voicemail, send an email or visit our website to leave a message for us! You can always email us for faster response!*

**ACCEPTANCE OF MAINTENANCE CONTRACT: (UPDATED OCTOBER 2019)** The above prices, specifications, and conditions are satisfactory and are hereby accepted. MJ Septic is authorized to enter property to perform routine maintenance inspections as agreed. I have read and agree to the maintenance contract guidelines stated above and have also read and agree to comply with the Maintenance Tips/Septic Guide. MJ Septic reserves the right to make amendments to this document at any time and the homeowner will be responsible for signing an updated version for office and county records.

*(MJ Septic will assess a \$75 service fee if we are not notified of gate code changes, aggressive dogs, etc.)*

Accepted and Approved by (signature): \_\_\_\_\_ Date of Acceptance: \_\_\_\_\_

Spouse/Authorized Persons to Approve Repairs & Pumping, Etc.: \_\_\_\_\_

Subdivision: \_\_\_\_\_ Gate Code(s): \_\_\_\_\_ Aggressive Dogs: \_\_\_\_\_

Email Address(es): \_\_\_\_\_

Cell Phone (his/hers): \_\_\_\_\_ Cell Phone (his/hers): \_\_\_\_\_ Home Phone: \_\_\_\_\_

**MJ Central Texas Septic, LLC Authorized Signature:** *Stephanie E. Perez*      **Office Approved:** \_\_\_\_\_

{ PAGE 3 - RETURN TO MJ SEPTIC }

**MJ SEPTIC Maintenance Tips and Owner's Septic Guide**

MJ SEPTIC  
27552 Old Blanco Road  
San Antonio, Texas 78260  
(210) 875-3625  
[mjseptic@mjseptic.com](mailto:mjseptic@mjseptic.com)  
[www.mjseptic.com](http://www.mjseptic.com)

To keep your system functioning properly, regular maintenance is required. No matter how well the system is maintained or how well your aerobic system is designed and household usage, there will be parts that need to be replaced. Some are less expensive (and more common) like diffuser bars (if required, not all brands use diffusers), filters, sprinkler heads, airline, float switches, timers, audio and visual alarms, etc. Some are more expensive like sprinkler pumps, air compressors and septic tank cleanings, etc. With owning an aerobic system, you should expect to have parts replaced and it needing to be cleaned/pumped out. The life span of each part of your system will vary depending upon how many people use your system, how much water is used, what types of food you eat, what medicines are taken, the type of cleaning chemicals being used in the household, what you flush down the commode and of course the regular life expectancy for each functioning part, etc.

Some of the items checked during routine inspections that may need to be replaced or repaired according to their life span. These items include, but are not limited to: air compressor (aerator), a/c filters, filter pads, diffuser bars, sprinkler pumps (irrigation pumps), control panels, electrical circuit boards, float switches, timers, audio alarms, visual alarms, airline, photocell's, toggle switches, wires, junction boxes, risers and/or lids, sprinkler heads, chlorinators, etc.

Below are some recommendations that will help you keep maintenance costs down and will help your aerobic system function properly.

- **RED LIGHT ALARMS:** if your alarm turns on, don't be alarmed (it usually isn't an emergency) Please call our office and schedule a service call with our office. If we are closed (after hours, weekends or holidays), please leave (1) voicemail at (210) 875-3625. You may also send a text to this number. You may email us to leave a request at [mjseptic@mjseptic.com](mailto:mjseptic@mjseptic.com) if you are unable to call or text. We will make a work order for the next available business day. During this time, you as the homeowner need to reduce all non-essential water usage. Don't wait days to report red light alarms! Please note, in extreme weather conditions, excessive heavy rains can and will cause your septic alarm and sprinkler heads to discharge, this is normal, the water is being relieved from the tank. If your alarm light stays on well after the rains have ceased, please call us to get a technician out to your property.

- **POWER:** In the event of a red-light alarm or at any other time NEVER shut off the power to your system!

- **IRRIGATION SYSTEMS (lawn care) & ALTERATIONS TO THE SYSTEM:** Avoid spraying your irrigation system in the same areas as your septic spray areas. This will cause over saturation to the lawn. Homeowners, landscapers, irrigation and pool companies should NEVER replace or tamper with your aerobic system, including the spray heads. Doing such will void any warranties (if applicable) and may result in additional costs to the homeowner for necessary repairs to bring the system back into compliance. For any changes wanted or needed for swimming pools, decks, sport courts, patios or irrigation systems, it is the homeowner's responsibility to call MJ Septic, LLC at (210) 875-3625 to assist in taking the necessary measures to have alterations made. This usually requires the system to be redesigned by one of our septic designers and re-permitted with your respective county. Do not build over any part of the aerobic system (the sprinklers can only be applied to natural vegetation surfaces!) Do not landscape over any part of the aerobic system (trees, plants, flowers, etc.) Do not allow ants to mound by any part of the aerobic system. Ant killer can be used to treat if mounds occur. (Ants will ruin electrical and void any warranties if applicable) Keep all vegetation mowed and trimmed around the entire system, including the spray heads & spray area. If the technician cannot access the system due to overgrown grass, weeds, bushes, etc. there will be a service call charge assessed to return for inspection.

- **CHLORINE (tablets & liquid):** Never store your tablets near water heaters or in your water heater closet. Keep chlorine away from gas and electrical. It is always best to store it in a cool, dry and well-ventilated area.

- \*\* **For tablet chlorinators:** use only chlorine that is designed to treat wastewater! Calcium Hypochlorite tablets are available at your local Home Depot or Lowe's. We do not sell them. NEVER USE SWIMMING POOL TABLETS! (mixing pool tablets with wastewater tablets could cause a dangerous volatile reaction. When the chlorinator is completely empty, do not add more than 4-5 tablets at a time to prevent the chlorinator from clogging.

- \*\* **For liquid chlorinators:** you may use liquid chlorine/bleach (same bleach used to wash whites) When the chlorinator is completely empty, add no more than 3 ½ gallons of liquid chlorine bleach at a time. We recommend 2-3 gallons monthly (this will vary depending on how much water is used in the home per month) Do not tamper with chlorinators! This will void any warranties (if applicable).

- **MISC INFO I:** An aerobic system should not be treated as city sewer. Economy in the use of water helps prevent overloading the system. Leaky faucets, running commodes, etc. should be guarded against as well. Avoid doing all your laundry in the same day (try to space to 1-2 loads daily); surges of water entering the system can and will hydraulically overload the system and throw off the balance of bacteria, which will not allow your waste to break down properly.

- **MISC INFO II:** Items flushed down commodes and/or poured down the drains DO NOT disappear; they must be treated by the system! Aerobic systems are designed to treat domestic wastewater and most toilet paper (read labels). Things that can harm your system include, but are not limited to are: excessive use of garbage disposal (very light use is okay, only if necessary, otherwise it is strongly recommended against!) fat, grease, oils, too many harsh cleaners, excessive use of fabric softener, excessive use of bleach, cigarette butts, feminine wipes, baby wipes, facial wipes, cleaning wipes, any type of wipes, feminine products, paper towels, condoms, q-tips, paint and/or paint thinners, varnishes, drain cleaners, automatic toilet bowl cleaners, hair combings, pet hair, coffee grounds, fruit, fruit peels, dental floss, any type of diapers, kitty litter, gauze bandages, unused medications, etc. Items such as these even though they may say "flushable" or "septic safe" still may not be ultimately safe for your aerobic treatment unit and cannot potentially cause the homeowner additional expenses for repairs and pumping.

- **MISC INFO III:** We take sludge level readings at every routine inspection (every four months) unless the system has been shut off/power failure or the system is overflowing. We always recommend cleaning/pumping of the system when levels reach 10-12" of sludge. \*A typical/average household will need to have their system cleaned/pump every 2-5 years; this all depends on usage and WILL VARY per HOUSEHOLD! This fee is NOT included in your annual maintenance contract agreement.

Date Printed: 12/11/2020



**MJ Septic, LLC**  
27552 Old Blanco Road  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com    mjseptic@mjseptic.com

To: **Kenneth & Sharon Dearmond**  
108 Paradise Hills  
New Braunfels, TX 78132

Printed: 1/4/2021  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Customer ID: 4589

Agency: Comal County Environmental Health

Contract Dates: 1/30/2021 - 1/30/2022

County: Comal

Sub: River Chase

Scheduled Date: 1/30/2021

Inspection 6 of 6

Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP

Treatment Type: Aerobic

Disposal: Surface Application

**Service Type: Scheduled Inspection**

☒ This counts as a type of "Scheduled Inspection"

Visit Date: **12/29/2020**

Time In: 2:30pm

Entered By: Ashley Nicole Larcom

Method: **Other**

☒ Copy emailed to Customer

Customer Emailed: 12/29/2020

Technician: Colton Lewis

☒ Copy emailed to the Agency

Agency Emailed: 1/4/2021

Maint. Provider: Michael J. Long

Aerators: Operational

**Sludge Levels**

Filters: Operational

For Tank 1: 1-2

Irrigation Pumps: Operational

Disinfection Device: Operational

Chlorine Supply: Operational

Chlorine Residual: 0.1mg/L

Tank Lid / Riser: Secured

Electric Circuits: Operational

Distribution System: Operational

Sprayfield Veg: Operational

Odor: Good

Alarm: Operational

**Comments**

☒ **Service Completed**

- Technician Secured the Tank Lid and/or Riser prior to leaving location.

- \*Septic tank cleaning is recommended between 10 and 12 inches of sludge in the pump tank (tank 1) or unless otherwise recommended by technician for other reasons such as full trash tank, etc.\*

- \*This inspection report is not valid for any real estate transactions\* - Copy emailed to the customer on 12/29/2020.

Insp ID #:35620

Provider: Michael J. Long

License Info: MP0001294 Expires: 8/31/2022

**MJ Septic, LLC**  
27552 Old Blanco Road  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com mjseptic@mjseptic.com

To: **Kenneth & Sharon Dearmond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Printed: 6/11/2021  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Agency: Comal County Environmental Health  
County: Comal Sub: River Chase  
Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP  
Treatment Type: Aerobic  
Disposal: Surface Application

Customer ID: 4589

Contract Dates: 1/30/2021 - 1/30/2022

Scheduled Date: 5/30/2021

Inspection 1 of 3

**Service Type: Scheduled Inspection**

**Visit Date: 5/20/2021**

Time In: 3:11 pm

**Method: Other**

**Technician: Manuel Guerrero**

**Maint. Provider: Michael J. Long**

☒ This counts as a type of "Scheduled Inspection"

**Entered By: Brianna Perez**

☒ Copy emailed to Customer

Customer Emailed: 6/2/2021

☒ Copy emailed to the Agency

Agency Emailed: 6/11/2021

**Aerators: Operational**

**Filters: Operational**

**Irrigation Pumps: Operational**

**Disinfection Device: Operational**

**Chlorine Supply: Operational**

**Chlorine Residual: 0.1mg/L**

**Sludge Levels**

**For Tank 1: 1"**

**Chlorinator: Op**

**Tank Lid / Riser: Secured**

**Electric Circuits: Operational**

**Distribution System: Operational**

**Sprayfield Veg: Operational**

**Odor: Good**

**Alarm: Operational**

**Comments**

☒ **Service Completed**

- Tech reset your timer.
- Technician Secured the Tank Lid and/or Riser prior to leaving location.
- \*Septic tank cleaning is recommended between 10 and 12 inches of sludge in the pump tank (tank 1) or unless otherwise recommended by technician for other reasons such as full trash tank, etc.\*
- \*This inspection report is not valid for any real estate transactions\* - Copy emailed to the customer on 6/2/2021.

Insp ID #:38188

**Provider: Michael J. Long**

License Info: MP0001294 Expires: 8/31/2022



**MJ Septic, LLC**  
1328 W Borgfeld  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com    mjseptic@mjseptic.com

To: **Kenneth & Sharon Dearmond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Printed: 10/22/2021  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Agency: Comal County Environmental Health

County: Comal

Sub: River Chase

Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP

Treatment Type: Aerobic

Disposal: Surface Application

Customer ID: 4589

Contract Dates: 1/30/2021 - 1/30/2022

Scheduled Date: 9/30/2021

Inspection 2 of 3

Installed: 3/5/2019

Warranty End: 3/5/2021

**Service Type: Scheduled Inspection**

**Visit Date: 9/22/2021**

Time In: 4:50PM

**Method: Other**

**Technician: Manuel Guerrero**

**Maint. Provider: Michael J. Long**

☒ This counts as a type of "Scheduled Inspection"

**Entered By: Catherine Jefferson**

☒ Copy emailed to Customer

Customer Emailed: 9/27/2021

☒ Copy emailed to the Agency

Agency Emailed: 10/22/2021

**Aerators: Operational**

**Filters: Operational**

**Irrigation Pumps: Operational**

**Disinfection Device: Operational**

**Chlorine Supply: Operational**

**Chlorine Residual: 0.1mg/L**

**Sludge Levels**

**For Tank 1: 5"**

**Chlorinator: Op**

**Tank Lid / Riser: Secured**

**Electric Circuits: Operational**

**Distribution System: Operational**

**Sprayfield Veg: Operational**

**Alarm: Operational**

**Comments**

☒ **Service Completed**

- Tech reset your timer. - Technician Secured the Tank Lid and/or Riser prior to leaving location. - \*Septic tank cleaning is recommended between 10 and 12 inches of sludge in the pump tank (tank 1) or unless otherwise recommended by technician for other reasons such as full trash tank, etc.\* - \*This inspection report is not valid for any real estate transactions\* - Copy emailed to the customer on 9/27/2021.

Insp ID #:40387

**Provider: Michael J. Long**

License Info: MP0001294 Expires: 8/31/2022

**MJ Septic, LLC**  
1328 W Borgfeld  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com    mjseptic@mjseptic.com

**To: Kenneth & Sharon Dearmond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Printed: 1/28/2022  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Agency: Comal County Environmental Health

County: Comal

Sub: River Chase

Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP

Treatment Type: Aerobic

Disposal: Surface Application

Customer ID: 4589

Contract Dates: 1/30/2022 - 1/30/2023

Scheduled Date: 1/30/2022

Inspection 3 of 3

Installed: 3/5/2019

Warranty End: 3/5/2021

**Service Type: Scheduled Inspection**

**Visit Date: 1/20/2022**

Time In: 11:23 AM

**Method: Other**

**Technician: Deaundrae Ross**

**Maint. Provider: Michael J. Long**

☒ This counts as a type of "Scheduled Inspection"

**Entered By: Tracy Murphy**

☒ Copy emailed to Customer

Customer Emailed: 1/25/2022

☒ Copy emailed to the Agency

Agency Emailed: 1/28/2022

**Aerators: Operational**

**Filters: Operational**

**Irrigation Pumps: Operational**

**Disinfection Device: Operational**

**Chlorine Supply: Operational**

**Chlorine Residual: 0.1mg/L**

**Sludge Levels**

**For Tank 1: 3"**

☒ **Changed Diffusers**    Quantity: 1

**Tank Lid / Riser: Secured**

**Electric Circuits: Operational**

**Distribution System: Operational**

**Sprayfield Veg: Operational**

**Alarm: Operational**

**Comments**

☒ **Service Completed**

- Tech reset your timer. - Technician Secured the Tank Lid and/or Riser prior to leaving location. - \*Septic tank cleaning is recommended between 10 and 12 inches of sludge in the pump tank (tank 1) or unless otherwise recommended by technician for other reasons such as full trash tank, etc.\* - \*This inspection report is not valid for any real estate transactions\*

- Tech changed Diffusers on the system on 1/20/2022. - Copy emailed to the customer on 1/25/2022.

Insp ID #:42611

**Provider: Michael J. Long**

License Info: MP0001294 Expires: 8/31/2022



**MJ Septic, LLC**  
1328 W Borgfeld  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com    mjseptic@mjseptic.com

To: **Kenneth & Sharon Dearmond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Printed: 11/2/2022  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Agency: Comal County Environmental Health

County: Comal

Sub: River Chase

Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP

Treatment Type: Aerobic

Disposal: Surface Application

Customer ID: 4589

Contract Dates: 1/30/2022 - 1/30/2023

Scheduled Date: 9/30/2022

Inspection 2 of 3

Installed: 3/5/2019

Warranty End: 3/5/2021

**Service Type: Scheduled Inspection**

**Visit Date: 9/22/2022**

Time In: 4:26PM

**Method: Other**

**Technician: Manuel Guerrero**

**Maint. Provider: Michael J. Long**

☒ This counts as a type of "Scheduled Inspection"

**Entered By: Catherine Jefferson**

☒ Copy emailed to Customer

Customer Emailed: 9/26/2022

☒ Copy emailed to the Agency

Agency Emailed: 11/2/2022

**Aerators: Operational**

**Filters: Operational**

**Irrigation Pumps: Operational**

**Disinfection Device: Operational**

**Chlorine Supply: Operational**

**Chlorine Residual: 0.1mg/L**

**Sludge Levels**

**For Tank 1: 4"**

**Chlorinator: Op**

**Tank Lid / Riser: Secured**

**Electric Circuits: Operational**

**Distribution System: Operational**

**Sprayfield Veg: Operational**

**Alarm: Operational**

**Comments**

☒ **Service Completed**

- Tech reset your timer. - Technician Secured the Tank Lid and/or Riser prior to leaving location. - \*Septic tank cleaning is recommended between 10 and 12 inches of sludge in the pump tank (tank 1) or unless otherwise recommended by technician for other reasons such as full trash tank, etc.\* - \*This inspection report is not valid for any real estate transactions\* - Copy emailed to the customer on 9/26/2022.

Insp ID #:47208

**Provider: Michael J. Long**

License Info: MP0001294 Expires: 8/31/2022

**MJ Septic, LLC**  
1328 W Borgfeld  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com    mjseptic@mjseptic.com

To: **Kenneth & Sharon De Armond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Printed: 7/28/2023  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Agency: Comal County Environmental Health

County: Comal

Sub: River Chase

Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP

Treatment Type: Aerobic

Disposal: Surface Application

Customer ID: 4589

Contract Dates: 1/30/2023 - 1/30/2026

Scheduled Date: 5/30/2023

Inspection 1 of 9

Installed: 3/5/2019

Warranty End: 3/5/2021

**Service Type: Scheduled Inspection**

☒ This counts as a type of "Scheduled Inspection"

**Visit Date: 5/17/2023**

Time In: 1:42 pm

Out: 1:54 pm

**Method: Other**

**Technician: Steve Chavarria**

**Maint. Provider: Michael J. Long**

**Entered By: Brianna Perez**

☒ Copy emailed to Customer

Customer Emailed: 5/18/2023

☒ Copy emailed to the Agency

Agency Emailed: 7/28/2023

**Aerators: Operational**

**Filters: Operational**

**Irrigation Pumps: Operational**

**Disinfection Device: Operational**

**Chlorine Supply: Operational**

**Chlorine Residual: 0.1mg/L**

**Sludge Levels**

**For Tank 1: 9"**

**Tank Lid / Riser: Secured**

**Electric Circuits: Operational**

**Distribution System: Operational**

**Sprayfield Veg: Operational**

**Alarm: Operational**

**Comments**

☒ **Service Completed**

- Tech reset your timer. - Technician Secured the Tank Lid and/or Riser prior to leaving location. - \*Septic tank cleaning is recommended between 10 and 12 inches of sludge in the pump tank (tank 1) or unless otherwise recommended by technician for other reasons such as full trash tank, etc.\* - \*This inspection report is not valid for any real estate transactions\* - Copy emailed to the customer on 5/18/2023.

Insp ID #:52297

**Provider: Michael J. Long**

License Info: MP0001294 Expires: 8/31/2025



**MJ Septic, LLC**  
1328 W Borgfeld  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com mjseptic@mjseptic.com

To: **Kenneth & Sharon Dearmond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Printed: 1/27/2023  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Agency: Comal County Environmental Health

County: Comal

Sub: River Chase

Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP

Treatment Type: Aerobic

Disposal: Surface Application

Customer ID: 4589

Contract Dates: 1/30/2022 - 1/30/2023

Scheduled Date: 1/30/2023

Inspection 3 of 3

Installed: 3/5/2019

Warranty End: 3/5/2021

**Service Type: Scheduled Inspection**

**Visit Date: 1/5/2023**

Out: 9:45AM

**Method: Other**

**Technician: Chris Hidalgo**

**Maint. Provider: Michael J. Long**

☒ This counts as a type of "Scheduled Inspection"

**Entered By: Catherine Jefferson**

☒ Copy emailed to Customer

Customer Emailed: 1/11/2023

☒ Copy emailed to the Agency

Agency Emailed: 1/27/2023

**Aerators: Operational**

**Filters: Operational**

**Irrigation Pumps: Operational**

**Disinfection Device: Operational**

**Chlorine Supply: Operational**

**Chlorine Residual: 0.1mg/L**

**Sludge Levels**

**For Tank 1: 6"**

**Chlorinator: Op**

**Tank Lid / Riser: Secured**

**Electric Circuits: Operational**

**Distribution System: Operational**

**Sprayfield Veg: Operational**

**Alarm: Operational**

**Comments**

☒ **Service Completed**

- \*\*\*This was your FINAL inspection for your current contract, please call (210) 875-3625 to renew your contract, to stay in compliance\*\*\*

- Tech reset your timer. - Technician Secured the Tank Lid and/or Riser prior to leaving location. - \*Septic tank cleaning is recommended between 10 and 12 inches of sludge in the pump tank (tank 1) or unless otherwise recommended by technician for other reasons such as full trash tank, etc.\* - \*This inspection report is not valid for any real estate transactions\* - Copy emailed to the customer on 1/11/2023.

Insp ID #:49489

**Provider: Michael J. Long**

License Info: MP0001294 Expires: 8/31/2025

**MJ Septic, LLC**  
1328 W Borgfeld  
San Antonio, TX 78260

Phone: (210) 875-3625

www.mjseptic.com    mjseptic@mjseptic.com

To: **Kenneth & Sharon De Armond**  
**108 Paradise Hills**  
**New Braunfels, TX 78132**

Printed: 10/6/2023  
Site: 108 Paradise Hills  
New Braunfels, TX 78132  
(817) 480-3066

Permit #: **108031**

Agency: Comal County Environmental Health

County: Comal

Sub: River Chase

Mfg / Brand: Pro Flo Aerobic Systems, LP - Pro Flo Aerobic Systems, LP

Treatment Type: Aerobic

Disposal: Surface Application

Customer ID: 4589

Contract Dates: 1/30/2023 - 1/30/2026

Scheduled Date: 9/30/2023

Inspection 2 of 9

Installed: 3/5/2019

Warranty End: 3/5/2021

**Service Type: Scheduled Inspection**

☒ This counts as a type of "Scheduled Inspection"

**Visit Date: 9/26/2023**

Time In: 2:12 pm

Out: 2:28 pm

**Entered By: Brianna Perez**

☒ Copy emailed to Customer

Customer Emailed: 9/27/2023

☒ Copy emailed to the Agency

Agency Emailed: 10/6/2023

**Method: Other**

**Technician: Steve Chavarria**

**Maint. Provider: Michael J. Long**

**Aerators: Operational**

**Filters: Operational**

**Irrigation Pumps: Operational**

**Disinfection Device: Operational**

**Chlorine Supply: Operational**

**Chlorine Residual: 0.1mg/L**

**Sludge Levels**

**For Tank 1: 10-11"**

☒ **Pumping Needed**

**Tank Lid / Riser: Secured**

☒ **Problem  
Indicated**

**Electric Circuits: Operational**

**Distribution System: Operational**

**Sprayfield Veg: Operational**

**Alarm: Operational**

**Comments**

☒ **Service Completed**

- Technician noted that there was a problem or issue with this Scheduled Inspection. - Tank needs Pumping due to high sludge. - Please call the office at (210) 875-3625 to schedule pump out.

- Tech reset your timer. - Technician Secured the Tank Lid and/or Riser prior to leaving location. - \*Septic tank cleaning is recommended between 10 and 12 inches of sludge in the pump tank (tank 1) or unless otherwise recommended by technician for other reasons such as full trash tank, etc.\* - \*This inspection report is not valid for any real estate transactions\* - Copy emailed to the customer on 9/27/2023.

Insp ID #:55097

**Provider: Michael J. Long**

License Info: MP0001294 Expires: 8/31/2025