



COMAL COUNTY

ENGINEER'S OFFICE

License to Operate On-Site Sewage Treatment and Disposal Facility

Issued This Date: **12/10/2021** Permit Number: **113479**

Location Description: **7961 PRONGHORN DR
SPRING BRANCH, TX 78070**

Subdivision: **Deer River**
Unit: **2**
Lot: **188**
Block: **-**
Acreage: **0.6100**

Type of System: **Aerobic
Surface Irrigation**

Issued to: **CMH Homes Inc**

This license is authorization for the owner to operate and maintain a private facility at the location described in accordance to the rules and regulations for on-site sewerage facilities of Comal County, Texas, and the Texas Commission on Environmental Quality.

The license grants permission to operate the facility. It does not guarantee successful operation. It is the responsibility of the owner to maintain and operate the facility in a satisfactory manner.

Alterations to this permit including, but not limited to:

- Increase in the square feet of living area
- Increase in the number of bedrooms
- A change of use (i.e. residential to commercial)
- Relocation of system components (including the relocation of spray heads)
- Installation of landscaping
- Adding new structures to the system

may require a new permit. **It is the responsibility of the owner to apply for a new permit, if applicable.**

Inspection and licensing of a facility indicates only that the facility meets certain minimum requirements. It does not impede any governmental entity in taking the proper steps to prevent or control pollution, to abate nuisance, or to protect the public health.

This license to operate is valid for an indefinite period. The holder may transfer it to a succeeding owner, provided the

Licensing Authority
Comal County Environmental Health

Cecy Allen OS0036769

ENVIRONMENTAL HEALTH INSPECTOR

[Signature] **Asst.**
ENVIRONMENTAL HEALTH COORDINATOR

OS0035625

Comal County Environmental Health OSSF Inspection Sheet

Installer Name: _____

OSSF Installer #: _____

1st Inspection Date: _____

2nd Inspection Date: _____

3rd Inspection Date: _____

Inspector Name: _____

Inspector Name: _____

Inspector Name: _____

Permit#:		Address:					
No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
1	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Site and Soil Conditions Consistent with Submitted Planning Materials		285.31(a) 285.30(b)(1)(A)(iv) 285.30(b)(1)(A)(v) 285.30(b)(1)(A)(iii) 285.30(b)(1)(A)(ii) 285.30(b)(1)(A)(i)				
2	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Setback Distances Meet Minimum Standards		285.91(10) 285.30(b)(4) 285.31(d)				
3	SEWER PIPE Proper Type Pipe from Structure to Disposal System (Cast Iron, Ductile Iron, Sch. 40, SDR 26)		285.32(a)(1)				
4	SEWER PIPE Slope from the Sewer to the Tank at least 1/8 Inch Per Foot		285.32(a)(3)				
5	SEWER PIPE Two Way Sanitary - Type Cleanout Properly Installed (Add. C/O Every 100' &/or 90 degree bends)		285.32(a)(5)				
6	PRETREATMENT Installed (if required) TCEQ Approved List PRETREATMENT Septic Tank(s) Meet Minimum Requirements		285.32(b)(1)(G) 285.32(b)(1)(E)(iii) 285.32(b)(1)(E)(iv) 285.32(b)(1)(F) 285.32(b)(1)(B) 285.32(b)(1)(C)(i) 285.32(b)(1)(C)(ii) 285.32(b)(1)(D) 285.32(b)(1)(E) 285.32(b)(1)(A) 285.32(b)(1)(E)(ii)(II) 285.32(b)(1)(E)(i) 285.32(b)(1)(E)(ii)(I)				
7	PRETREATMENT Grease Interceptors if required for commercial		285.34(d)				

Inspector Notes:

**Comal County Environmental Health
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
8	SEPTIC TANK Tank(s) Clearly Marked SEPTIC TANK If Single Tank, 2 Compartments Provided with Baffle SEPTIC TANK Inlet Flowline Greater than 3" and " T " Provided on Inlet and Outlet SEPTIC TANK Septic Tank(s) Meet Minimum Requirements		285.32(b)(1) (E)285.91(2)285.32(b)(1) (F)285.32(b)(1)(E) (iii)285.32(b)(1)(E)(ii) (II)285.32(b)(1)(E)(ii) (I)285.32(b)(1)(E) (i)285.32(b)(1) (D)285.32(b)(1)(C) (ii)285.32(b)(1)(C) (i)285.32(b)(1) (B)285.32(b)(1) (A)285.32(b)(1)(E)(iv)				
9	ALL TANKS Installed on 4" Sand Cushion/ Proper Backfill Used		285.32(b)(1)(F) 285.32(b)(1)(G) 285.34(b)				
10	SEPTIC TANK Inspection / Clean Out Port & Risers Provided on Tanks Buried Greater than 12" Sealed and Capped		285.38(d)				
11	SEPTIC TANK Secondary restraint system provided SEPTIC TANK Riser permanently fastened to lid or cast into tank SEPTIC TANK Riser cap protected against unauthorized intrusions		285.38(d) 285.38(e)				
12	SEPTIC TANK Tank Volume Installed						
13	PUMP TANK Volume Installed						
14	AEROBIC TREATMENT UNIT Size Installed						
15	AEROBIC TREATMENT UNIT Manufacturer AEROBIC TREATMENT UNIT Model Number						
16	DISPOSAL SYSTEM Absorptive		285.33(a)(4) 285.33(a)(1) 285.33(a)(2) 285.33(a)(3)				
17	DISPOSAL SYSTEM Leaching Chamber		285.33(a)(1) 285.33(a)(3) 285.33(a)(4) 285.33(a)(2)				
18	DISPOSAL SYSTEM Evapo-transpirative		285.33(a)(3) 285.33(a)(4) 285.33(a)(1) 285.33(a)(2)				

**Comal County Environmental Health
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
19	DISPOSAL SYSTEM Drip Irrigation		285.33(c)(3)(A)-(F)				
20	DISPOSAL SYSTEM Soil Substitution		285.33(d)(4)				
21	DISPOSAL SYSTEM Pumped Effluent		285.33(a)(4) 285.33(a)(3) 285.33(a)(1) 285.33(a)(2)				
22	DISPOSAL SYSTEM Gravelless Pipe		285.33(a)(3) 285.33(a)(2) 285.33(a)(4) 285.33(a)(1)				
23	DISPOSAL SYSTEM Mound		285.33(a)(3) 285.33(a)(1) 285.33(a)(2) 285.33(a)(4)				
24	DISPOSAL SYSTEM Other (describe) (Approved Design)		285.33(d)(6) 285.33(c)(4)				
25	DRAINFIELD Absorptive Drainline 3" PVC or 4" PVC						
26	DRAINFIELD Area Installed						
27	DRAINFIELD Level to within 1 inch per 25 feet and within 3 inches over entire excavation		285.33(b)(1)(A)(v)				
28	DRAINFIELD Excavation Width DRAINFIELD Excavation Depth DRAINFIELD Excavation Separation DRAINFIELD Depth of Porous Media DRAINFIELD Type of Porous Media						
29	DRAINFIELD Pipe and Gravel - Geotextile Fabric in Place		285.33(b)(1)(E)				
30	DRAINFIELD Leaching Chambers DRAINFIELD Chambers - Open End Plates w/Splash Plate, Inspection Port & Closed End Plates in Place (per manufacturers spec.)		285.33(c)(2)				
31	LOW PRESSURE DISPOSAL SYSTEM Adequate Trench Length & Width, and Adequate Separation Distance between Trenches		285.33(d)(1)(C)(i)				

**Comal County Environmental Health
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
32	EFFLUENT DISPOSAL SYSTEM Utilized Only by Single Family Dwelling EFFLUENT DISPOSAL SYSTEM Topographic Slopes < 2.0% EFFLUENT DISPOSAL SYSTEM Adequate Length of Drain Field (1000 Linear ft. for 2 bedrooms or Less & an additional 400 ft. for each additional bedroom) EFFLUENT DISPOSAL SYSTEM Lateral Depth of 18 inches to 3 ft. & Vertical Separation of 1ft on bottom and 2 ft. to restrictive horizon and ground water respectfully EFFLUENT DISPOSAL SYSTEM Lateral Drain Pipe (1.25 - 1.5" dia.) & Pipe Holes (3/16 - 1/4" dia. Hole Size) 5 ft. Apart		285.33(b)(3)(A) 285.33(b)(3)(A) 285.33(b)(3) (B)285.91(13) 285.33(b)(3)(D) 285.33(b)(3)(F)				
33	AEROBIC TREATMENT UNIT Is Aerobic Unit Installed According to Approved Guidelines.		285.32(c)(1)				
34	AEROBIC TREATMENT UNIT Inspection/Clean Out Port & Risers Provided AEROBIC TREATMENT UNIT Secondary restraint system provided AEROBIC TREATMENT UNIT Riser permanently fastened to lid or cast into tank AEROBIC TREATMENT UNIT Riser cap protected against unauthorized intrusions						
35	AEROBIC TREATMENT UNIT Chlorinator Properly Installed with Chlorine Tablets in Place.						
36	PUMP TANK Is the Pump Tank an approved concrete tank or other acceptable materials & construction PUMP TANK Sampling Port Provided in the Treated Effluent Line PUMP TANK Check Valve and/or Anti- Siphon Device Present When Required PUMP TANK Audible and Visual High Water Alarm Installed on Separate Circuit From Pump						
37	PUMP TANK Inspection/Clean Out Port & Risers Provided PUMP TANK Secondary restraint system provided PUMP TANK Riser permanently fastened to lid or cast into tank PUMP TANK Riser cap protected against unauthorized intrusions						
38	PUMP TANK Secondary restraint system provided						
39	PUMP TANK Electrical Connections in Approved Junction Boxes / Wiring Buried						

**Comal County Environmental Health
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
40	APPLICATION AREA Distribution Pipe, Fitting, Sprinkler Heads & Valve Covers Color Coded Purple?		285.33(d)(2)(G)(iii)(II) 285.33(d)(2)(G)(iii)(III) 285.33(d)(2)(G)(v) 285.33(d)(2)(G)(iii) 285.33(d)(2)(G)(iv) 285.33(d)(2)(G)(i) 285.33(d)(2)(G)(ii) 285.33(d)(2)(G)(iii)(I)				
41	APPLICATION AREA Low Angle Nozzles Used / Pressure is as required APPLICATION AREA Acceptable Area, nothing within 10 ft of sprinkler heads? APPLICATION AREA The Landscape Plan is as Designed		285.33(d)(2)(G) (i)285.33(d)(2) (A)285.33(d)(2)(F)				
42	APPLICATION AREA Area Installed						
43	PUMP TANK Meets Minimum Reserve Capacity Requirements						
44	PUMP TANK Material Type & Manufacturer						
45	PUMP TANK Type/Size of Pump Installed						



COMAL COUNTY

ENGINEER'S OFFICE

Permit of Authorization to Construct an On-Site Sewage Facility Permit Valid For One Year From Date Issued

Permit Number: 113479
Issued This Date: 10/27/2021
This permit is hereby given to: CMH Homes Inc

To start construction of a private, on-site sewage facility located at:

7961 PRONGHORN DR
SPRING BRANCH, TX 78070

Subdivision: Deer River
Unit: 2
Lot: 188
Block: -
Acreage: 0.6100

APPROVED MINIMUM SIZES AS PER ATTACHED DESIGN

Type of System: Aerobic
Surface Irrigation

This permit gives permission for the construction of the above referenced on-site facility to commence. Installation must be completed by an installer holding a valid registration card from the Texas Commission on Environmental Quality (TCEQ). Installation and inspection must comply with current TCEQ and Comal County requirements.

Call (830) 608-2090 to schedule inspections.

RECEIVED

By KG at 12:12 pm, Oct 25, 2021



COMAL COUNTY

ENGINEER'S OFFICE

OSSF DEVELOPMENT APPLICATION CHECKLIST

Staff will complete shaded items

		113479
Date Received	Initials	Permit Number


Instructions:

Place a check mark next to all items that apply. For items that do not apply, place "N/A". This OSSF Development Application Checklist **must** accompany the completed application.

OSSF Permit

- Completed Application for Permit for Authorization to Construct an On-Site Sewage Facility and License to Operate
- Site/Soil Evaluation Completed by a Certified Site Evaluator or a Professional Engineer
- Planning Materials of the OSSF as Required by the TCEQ Rules for OSSF Chapter 285. Planning Materials shall consist of a scaled design and all system specifications.
- Required Permit Fee - See Attached Fee Schedule
- Copy of Recorded Deed
- Surface Application/Aerobic Treatment System
 - Recorded Certification of OSSF Requiring Maintenance/Affidavit to the Public
 - Signed Maintenance Contract with Effective Date as Issuance of License to Operate

I affirm that I have provided all information required for my OSSF Development Application and that this application constitutes a completed OSSF Development Application.

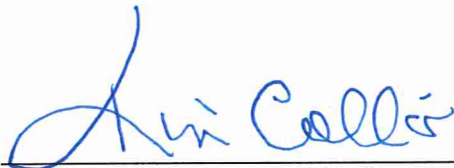

 Signature of Applicant



 Date

___ COMPLETE APPLICATION
Check No. _____ Receipt No. _____

INCOMPLETE APPLICATION (Missing Items Circled, Application Refused)
--



ON-SITE SEWAGE FACILITY APPLICATION

Date 10-13-2021

Permit Number 113479

1. APPLICANT / AGENT INFORMATION

Owner Name CMH Homes Inc.
Mailing Address 500 Clayton Road
City, State, Zip Maryville, TN 37804
Phone # _____
Email wintersseptics@gvtc.com

Agent Name Doug Dowlearn R.S.
Agent Address 703 Oak Drive
City, State, Zip Blanco, TX 78606
Phone # 210-240-2101
Email txseptic@gmail.com

2. LOCATION

Subdivision Name Deer River Unit 2 Lot 188 Block _____
Survey Name / Abstract Number _____ Acreage 0.6080
Address 7961 Pronghorn Drive City Spring Branch State TX Zip 78070

3. TYPE OF DEVELOPMENT

Single Family Residential

Type of Construction (House, Mobile, RV, Etc.) House

Number of Bedrooms 4

Indicate Sq Ft of Living Area 2001

Non-Single Family Residential

(Planning materials must show adequate land area for doubling the required land needed for treatment units and disposal area)

Type of Facility _____

Offices, Factories, Churches, Schools, Parks, Etc. - Indicate Number Of Occupants _____

Restaurants, Lounges, Theaters - Indicate Number of Seats _____

Hotel, Motel, Hospital, Nursing Home - Indicate Number of Beds _____

Travel Trailer/RV Parks - Indicate Number of Spaces _____

Miscellaneous _____

Estimated Cost of Construction: \$ 160,000 (Structure Only)

Is any portion of the proposed OSSF located in the United States Army Corps of Engineers (USACE) flowage easement?

Yes No (If yes, owner must provide approval from USACE for proposed OSSF improvements within the USACE flowage easement)

Source of Water Public Private Well

4. SIGNATURE OF OWNER

By signing this application, I certify that:

- The completed application and all additional information submitted does not contain any false information and does not conceal any material facts. I certify that I am the property owner or I possess the appropriate land rights necessary to make the permitted improvements on said property.
- Authorization is hereby given to the permitting authority and designated agents to enter upon the above described property for the purpose of site/soil evaluation and inspection of private sewage facilities..
- I understand that a permit of authorization to construct will not be issued until the Floodplain Administrator has performed the reviews required by the Comal County Flood Damage Prevention Order.
- I affirmatively consent to the online posting/public release of my e-mail address associated with this permit application, as applicable.

10-15-2021
Date

Signature of Owner

***** COMAL COUNTY OFFICE OF ENVIRONMENTAL HEALTH *****
APPLICATION FOR PERMIT FOR AUTHORIZATION TO CONSTRUCT AN
ON-SITE SEWAGE FACILITY AND LICENSE TO OPERATE

Planning Materials & Site Evaluation as Required Completed By _____

System Description _____

Size of Septic System Required Based on Planning Materials & Soil Evaluation

Tank Size(s) (Gallons) _____ Absorption/Application Area (Sq Ft) _____

Gallons Per Day (As Per TCEQ Table III) _____

(Sites generating more than 5000 gallons per day are required to obtain a permit through TCEQ.)

Is the property located over the Edwards Recharge Zone? Yes No

(If yes, the planning materials must be completed by a Registered Sanitarian (R.S.) or Professional Engineer (P.E.))

Is there an existing TCEQ approved WPAP for the property? Yes No

(If yes, the R.S. or P.E. shall certify that the OSSF design complies with all provisions of the existing WPAP.)

If there is no existing WPAP, does the proposed development activity require a TCEQ approved WPAP? Yes No

(If yes, the R.S. or P.E. shall certify that the OSSF design will comply with all provisions of the proposed WPAP. A Permit to Construct will not be issued for the proposed OSSF until the proposed WPAP has been approved by the appropriate regional office.)

Is the property located over the Edwards Contributing Zone? Yes No

Is there an existing TCEQ approval CZP for the property? Yes No

(If yes, the P.E. or R.S. shall certify that the OSSF design complies with all provisions of the existing CZP.)

If there is no existing CZP, does the proposed development activity require a TCEQ approved CZP? Yes No

(If yes, the R.S. or P.E. shall certify that the OSSF design will comply with all provisions of the proposed CZP. A Permit to Construct will not be issued for the proposed OSSF until the CZP has been approved by the appropriate regional office.)

Is this property within an incorporated city? Yes No

If yes, indicate the city: _____

By signing this application, I certify that:

- The information provided above is true and correct to the best of my knowledge.

- I affirmatively consent to the online posting/public release of my e-mail address associated with this permit application, as applicable.



Signature of Designer

Date

40



202106054540 10/19/2021 03:16:56 PM 1/1

COUNTY OF COMAL
STATE OF TEXAS

AFFIDAVIT TO THE PUBLIC

CERTIFICATION OF OSSF REQUIRING MAINTENANCE

According to Texas Commission on Environmental Quality (TCEQ) Rules for On-Site Sewage Facilities (OSSFs), this document is filed in the Deed Records of Comal County, Texas.

I
The Texas Health and Safety Code, Chapter 366 authorizes the Texas Commission on Environmental Quality (TCEQ) to regulate on-site sewage facilities (OSSFs). Additionally, the Texas Water Code (TWC), § 5.012 and § 5.013, give the commission primary responsibility for implementing the laws of the State of Texas relating to water and adopting rules necessary to carry out its powers and duties under the TWC. The commission, under the authority of the TWC and the Texas Health and Safety Code, requires owners to provide notice to the public that certain types of OSSFs are located on specific pieces of property. To achieve this notice, the commission requires a recorded affidavit. Additionally, the owner must provide proof of the recording to the OSSF permitting authority. This recorded affidavit is not a representation or warranty by the commission of the suitability of this OSSF, nor does it constitute any guarantee by the commission that the appropriate OSSF was installed.

II
An OSSF requiring a maintenance contract, according to 30 Texas Administrative Code § 285.91 (12) will be installed on the property described as (insert legal description): Lot 188, Deer River Phase 2

The property is owned by (Insert owner's full name): CMH Homes Inc.


This OSSF must be covered by a continuous maintenance contract for the first two years. After the initial two-year service policy, the owner of an aerobic treatment system for a single family residence shall either obtain a maintenance contract within 30 days or maintain the system personally.

Upon sale or transfer of the above described property, the permit for the OSSF shall be transferred to the buyer or new owner. A copy of the planning materials for OSSF may be obtained from **Comal County Engineer's Office**.

WITNESS BY HAND(S) ON THIS 18th DAY OF October, 2021
[Signature] Kimberly Collier
Owner(s) signature(s) (PRINTED NAME)

SWORN TO AND SUBSCRIBED BEFORE ME ON THIS 18th DAY OF October, 2021

Notary Public, State of Texas
Notary's Printed Name: Roxianne M. Maurelli
My Commission Expires: August 6, 2021

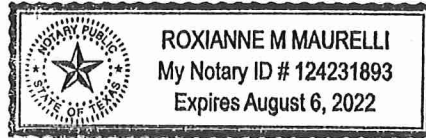

Filed and Recorded
Official Public Records
Bobbie Koepf, County Clerk
Comal County, Texas
10/19/2021 03:16:56 PM
CASHFOUR 1 Page(s)
202106054540



Bobbie Koepf

DAVID WINTERS SEPTICS, LLC
PO BOX 195
SPRING BRANCH, TX 78070
830-935-2477 OFFICE
830-935-2477 FAX
wintersseptics@gvtc.com

Routine Maintenance and Inspection Agreement

This Work-for-Hire Agreement (hereafter referred to as this "Agreement") is entered into, by, and between CMH Homes Inc. (referred to as "Client") and David Winters Septic's, LLC, Inc. (hereafter referred to as "Contractor") located at 7961 Pronghorn Drive Date beginning on Issue Date of License to Operate and contract ending 2 years from Issue Date of License to Operate License to Operate
By this agreement the Contractor agrees to render professional service, as described herein, and the Client agrees to fulfill the terms of this Agreement as described herein.

This agreement will provide for all required inspections, testing, and service for your Aerobic Treatment System. The policy will include the following:

1. Three (3) inspections per year/service calls (at least one every four months), for a total of six (6) over the two-year period, including inspection, adjustment, and servicing of the mechanical, electrical and other applicable component parts to ensure proper function. This includes inspecting control panel, air pumps, air filters, diffuser operation, and replacing or repairing any component not found to be functioning correctly. Any alarm situations affecting the proper function of the Aerobic process will be addressed within a 48-hour time frame. This contract does not include labor on warranty and non-warranty parts.
2. An effluent quality inspection consisting of a visual check of color, turbidity, scum overflow and examination for odors. A test for chlorine residual and pH will be taken and reported as necessary.
3. If any improper operation is observed, which cannot be corrected at the time of the service visit, you will be notified on your inspection report.
4. The Client is responsible for the chlorine tablets and/or liquid chlorine; they must be filled before or during the service visit.
5. Any additional visits, inspections or sample collection required by specific Municipalities, Water/River Authorities, and County Agencies the TCEQ or any other authorized regulatory agency in your jurisdiction will not be covered by this policy.

At the conclusion of the initial service policy, our company will make available, for purchase on an annual basis, a continuing service policy cover NORMAL inspection, maintenance and repair.

The Homeowners Manual must be strictly followed or warranties are subject invalidation. Pumping of sludge build up is not covered by this policy and will result in additional charges.

This agreement does not cover any labor or parts for items which must be replaced due to acts of God, i.e., lightning strikes, high winds, flooding, freezing.

This agreement DOES NOT COVER materials or parts which must be replaced due to misuse or abuse of the system. These include but are not limited to: Sewage flows exceeding the recommended daily hydraulic design capabilities, Disposal of Non-Biodegradable materials, such as chemicals, grease or oil, sanitary napkins, tampons, baby wipes, disposable diapers, Clogs in the line between the house and the tank.

This agreement DOES NOT COVER LABOR OR PARTS for out- of- warranty items.

ACCESS BY CONTRACTOR

The contractor or anyone authorized by the contractor may enter the property at reasonable times without prior notice for the purpose of service described above.

PAYMENT AGREEMENT

The client will pay compensation to the contractor for the services in the amount of _____. This compensation shall be payable in one lump sum payment upon acceptance of this agreement. Payments not received within 30 days of the above described due date will be subject to a \$25.00 late penalty.

TERMINATION OF THIS AGREEMENT

Either party may terminate this agreement within 10 days of written notice in the event of substantial failure to perform in accordance with its terms by other party without fault of the terminating party. If this agreement is terminated, the contractor will immediately notify the appropriate health authority.

LIMIT OF LIABILITY

The Contractor will not be liable for indirect, consequential, incidental or punitive damages, whether in contract or any other theory. In no event shall the Contractor's liability for direct damages exceed the price for the services described in this agreement.

Permit # _____

The effective date of this initial maintenance agreement shall be the date the license to operate is issued.

Client

CMH Homes Inc.

Name

7961 Pronghorn Drive

Address

Spring Branch, TX 78070

City/State/Zip Code

830-549-5036

Phone Number

Ami Collier

Signature of Client

Contractor

David Winters Septic's, LLC, Inc.

P.O. Box 195

Spring Branch, Texas 780170

Office 830-935-2477 Fax 830-935-2477

By: *David Winters*

Signature of Contractor

Applicant Information:

Name: CMH Homes Inc.
Address: 500 Clayton Rd
City, State & Zip Code: Maryville, TN 37804
Phone:
Email:

Site Evaluator Information:

Name: Douglas R. Dowlearn
Company: D.A.D. Services, Inc.
Address: 703 Oak Drive
City, State & Zip: Blanco, TX 78606
Phone: (210)240-2101 **Fax:** (866)260-7687
Email: txseptic@gmail.com

Property Location:

Legal: Deer River, Unit 2, Lot 188
Street/Road Address: 7961 Pronghorn Drive
City: Spring Branch **Zip:** 78070
Additional Info: Comal County

Installer Information:

Name:
Company:
Address:
City, State & Zip:
Phone: **Fax:**

Depth	Texture Class	Soil Texture	Structure (For Class III – blocky, platy or massive)	Drainage (Mottles/Water Table)	Restrictive Horizon	Observation
Soil Boring #1 60"	III	0-12" Clay Loam 12"+ Limestone	Blocky	<30% Gravel	12"+ Limestone	None
Soil Boring #2 60"		Same as above				

DESIGN SPECIFICATIONS

Application Rate (RA): 0.064
OSSF is designed for: 4 Bedrooms (2001 sq. ft.)
300 gallons per day
An aerobic treatment/spray disposal system is to be utilized based on the site evaluation.
4688 sq. ft. disposal area required
600 gallon/day aerobic tank required
Calculations: Absorption Area: $Q/RA = 300/0.064 = 4688$ Sq. Ft.

FEATURES OF SITE AREA

Presence of 100-year flood zone: NO
Existing or proposed water well in nearby area: NO
Presence of adjacent ponds, streams, water impoundments: NO
Presence of upper water shed: NO
Organized sewage service available to lot: NO

I certify that the findings of this report are based on my field observations and are accurate to the best of my ability. The site evaluation and OSSF design are subject to approval by the TCEQ or the local authorized agent. The planning materials and the OSSF design should not be considered final until a permit to construct has been issued.

Site Evaluator:

NAME: Douglas R. Dowlearn, R.S.
Signature:

License No. OS9902 – Exp. 6/30/2023
TDH: #2432 – Exp. 2/28/2023

D.A.D SERVICES, INC.
DOUG DOWLEARN
703 OAK DRIVE, BLANCO, TX 78606
Designed for:
CMH Homes Inc.


The installation site is at lot 188 of the Deer River Unit 2 subdivision in Comal County, TX. The proposed OSSF will treat the wastewater from a 4 bedroom(2001 sf) residence. The proposed method of wastewater treatment is aerobic treatment with spray irrigation. This method was chosen because of unsuitable soil conditions.

PROPOSED SYSTEM:

A 4" PVC pipe will discharge from the residence to a pre-treatment tank, which flows into a 600 gpd aerobic treatment plant. The aerobic tank effluent flows to a 768 gallon storage/pump tank containing a liquid chlorinator and a single 20 gpm submersible pump. Distribution is through 3 K-Rain Gear Driven pop-up sprinklers, with low angle (13 degrees) spray nozzles spraying at 40 psi. One sprinkler will spray a radius of 38 feet at 180 degrees of arc; Two sprinklers will spray radii of 31 feet at 180 degrees of arc. An audio and visual alarm monitoring both high water and aerator failure will be placed in a noticeable location.

DESIGN SPECIFICATIONS:

Daily Waste Flow: 300 gpd
Application rate: 0.064
Application area required: $300/.064 = 4688$ ft. sq.
Application area utilized: 4854 sq. ft.
Pump tank reserve capacity: 150 gal minimum

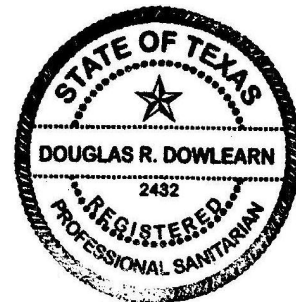

Douglas R. Dowlearn

SYSTEM COMPONENTS:

SCH 40 PVC sewer line
1" purple PVC supply line
600 gpd aerobic treatment plant with timed controls set to spray in the pre-dawn hours of midnight to 5:00 am
Liquid chlorinator
Pre-treatment tank and 768 gallon pump tank
3 K-Rain Gear Driven pop-up sprinklers

LANDSCAPING:

The native vegetation in the distribution area should consist of low level shrubs, plains grass, bluestem or bermuda. The entire area of the spray must maintain a ground cover after construction. In the event the natural cover is disturbed, a suitable ground cover must be installed on all excavated areas.

Douglas R. Dowlearn
D.A.D. Services, Inc.
703 Oak Drive
Blanco, TX 78606
(210)240-2101
txseptic@gmail.com

October 13, 2021

RE: 7961 Pronghorn Drive, Spring Branch, TX 78070

To Whom It May Concern:

I am requesting a variance for the placement of a spray disposal area 10 feet from the property line, but less than 20 feet from the property line as Comal County regulations require. This setback complies with TCEQ CHAPTER 285 rules Table X. requirements. Equivalent protection will be maintained by including a battery backup to the timer clock to assure sprayers only spray during the predawn hours. In my professional opinion this variance will not pose a threat to the environment or public health.

If there are any questions or concerns, please contact me at 210.240.2101 or by email at txseptic@gmail.com .

Sincerely,




Douglas R. Dowlearn, R.S.




SCALE 1" = 30'

CMH HOMES INC.
7961 PRONGHORN DRIVE
SPRING BRANCH, TX 78070
DEER RIVER SUBDIVISION
UNIT 2, LOT 188
COMAL COUNTY/.608 ACRES

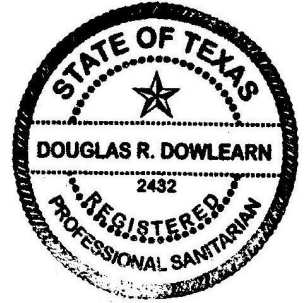

Douglas R. Dowlearn

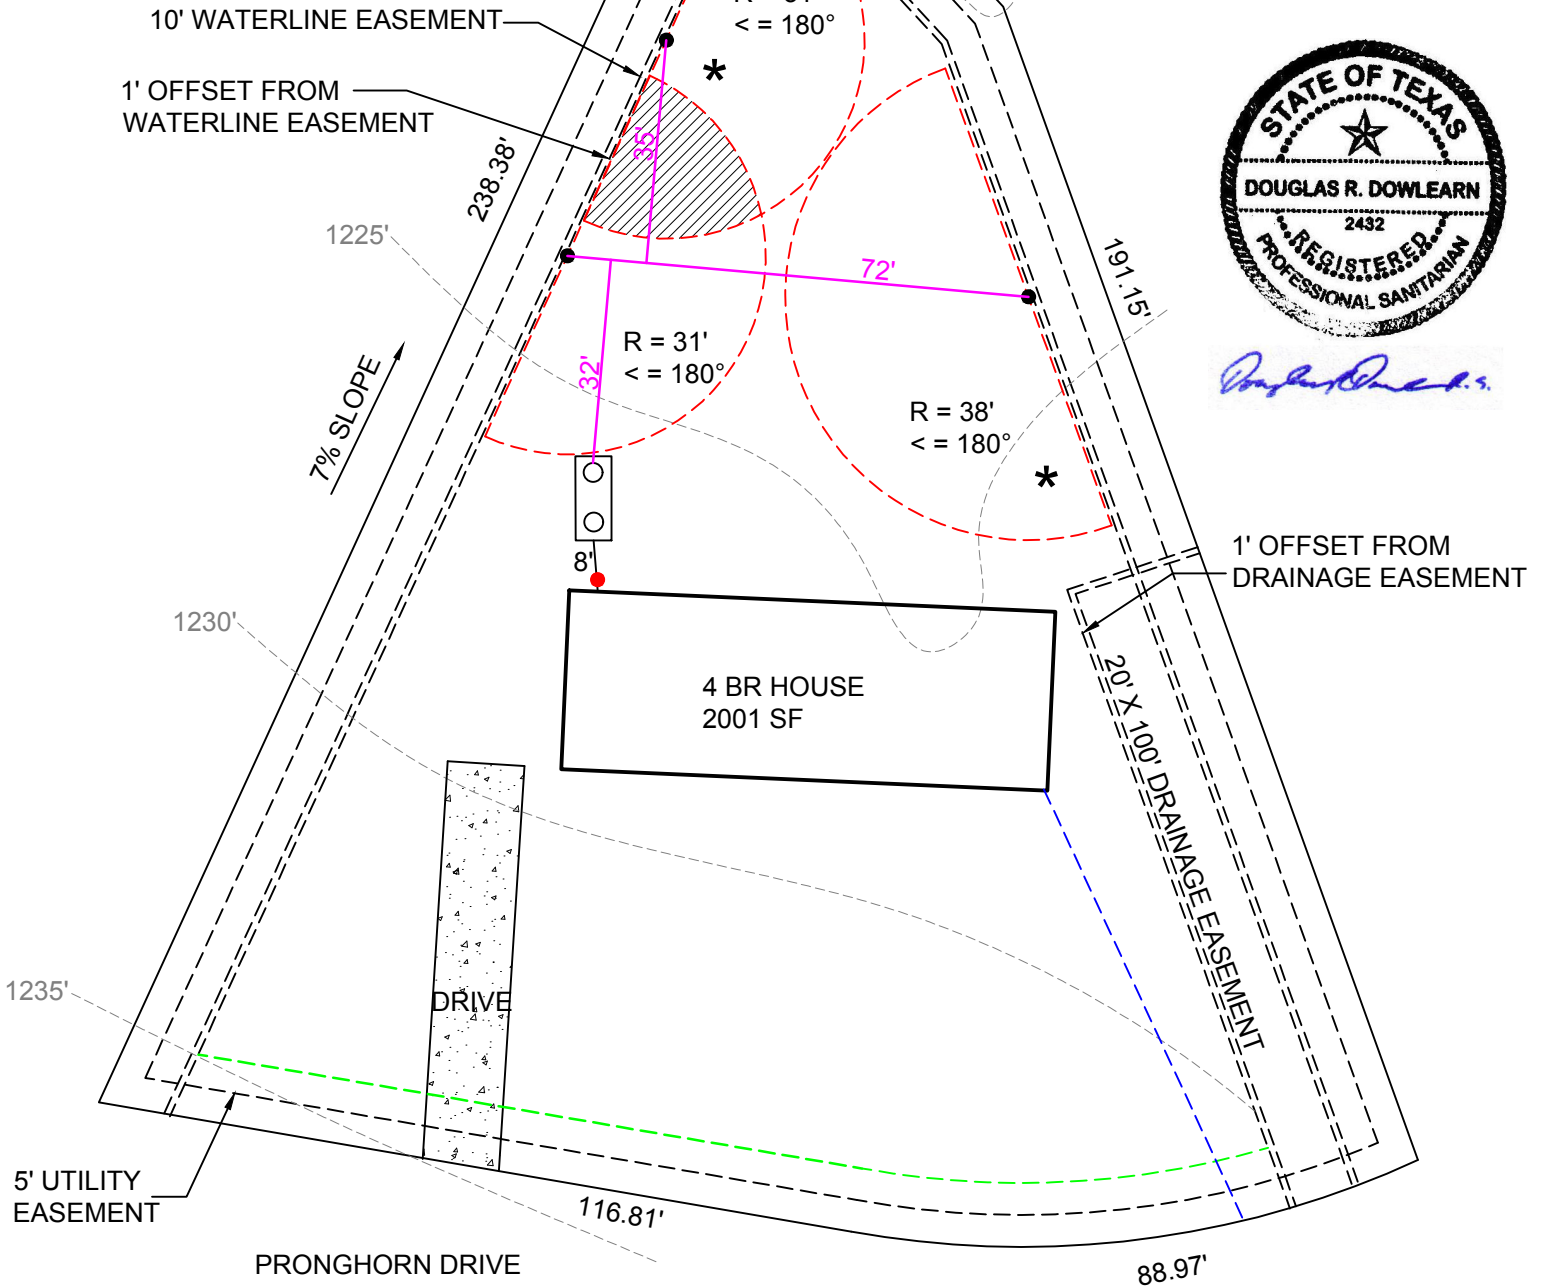


KEY

	- 2 WAY CLEANOUT
	- 10' OSSF SPRAY SETBACK
	- 1" SCH 40 PVC PURPLE PIPE
	- PROPOSED WATER LINE
	- TEST HOLE
	- 600 GPD AEROBIC TREATMENT UNIT
	- SPRAY OVERLAP AREA = 432 SF


NOTES:

- 1" SCH 40 PURPLE PIPE TO ALL SPRAY HEADS.
- 3" OR 4" SCH 40 PVC PIPE FROM STRUCTURE TO TANK.
- CLEANOUT WITHIN 3' OF STRUCTURE.
- TOTAL SPRAY AREA = 4854 SF.
- TANK WILL BE WATER TIGHT AND MANUFACTURED ACCORDING TO ASTM DESIGNATION: C 1227.

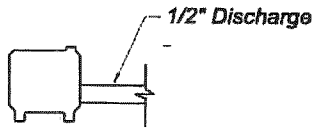


BLOWER

14.15 Gallons per inch

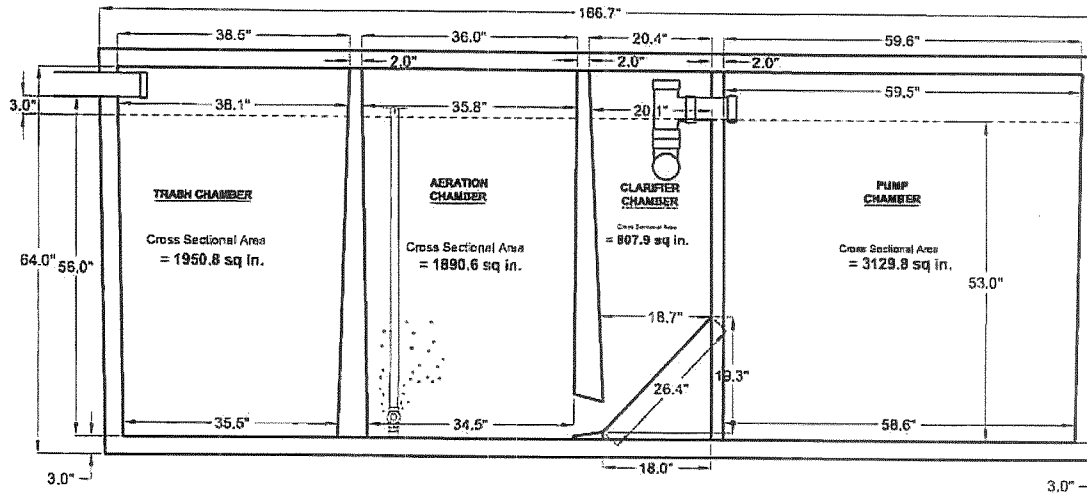


SIDE SECTION VIEW

SCALE: 1" = 3/8"

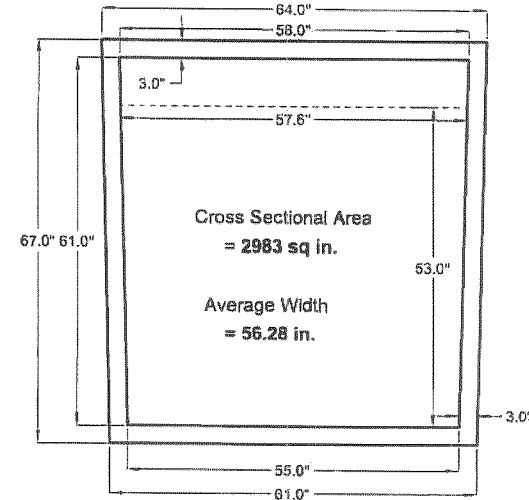

END SECTION VIEW


SCALE: 1" = 3/8"



DIFFUSER DETAIL

2 - 250 mm
Max flow per diffuser
= 55 liters/minute

42" - 53" - Reserve - 156 Gallons
42" - Alarm
14" - 42" - Working Level - 396 Gallons
11" - 14" - On/Off Tether - 42 Gallons
0-11" - Sump - 156 Gallons

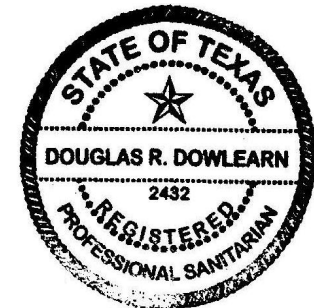

Douglas R. Dowlearn

Title: **Model D-600-m**
600 gallon per day Aerobic Treatment Unit

Company Name: **Aeris Aerobics**

Date: **2-22-2015**

Independence Title Company
GF# 2150704-SH SA

General Warranty Deed

NOTICE OF CONFIDENTIALITY RIGHTS

IF YOU ARE A NATURAL PERSON, YOU MAY REMOVE OR STRIKE ANY OF THE FOLLOWING INFORMATION FROM ANY INSTRUMENT THAT TRANSFERS AN INTEREST IN REAL PROPERTY BEFORE IT IS FILED FOR RECORD IN THE PUBLIC RECORDS: YOUR SOCIAL SECURITY NUMBER OR YOUR DRIVER'S LICENSE NUMBER.

Date: September 1st, 2021

Grantor: Mark Harris

Grantor's Mailing Address: Tall Sunrise Lake, San Antonio, TX 78244

Grantee: CMH Homes Inc.

Grantee's Mailing Address: 500 Clayton Rd, Maryville, TN 37804

Consideration: Cash and other good and valuable consideration.

Property (including any improvements):

Lot 188, DEER RIVER PHASE 2, situated in Comal County, according to the map or plat thereof, recorded in Volume 8, Pages 359-361, Map and Plat Records, Comal County, Texas.

Reservations from Conveyance: None

Exceptions to Conveyance and Warranty:

Liens described as part of the Consideration and any other liens described in this deed as being either assumed or subject to which title is taken; validly existing easements, rights-of-way, and prescriptive rights, whether of record or not; all presently recorded and validly existing restrictions, reservations, covenants, conditions, oil and gas leases, mineral interests outstanding in persons other than Grantor, and other instruments, other than conveyances of the surface fee estate, that affect the Property; validly existing rights of adjoining owners in any walls and fences situated on a common boundary; any discrepancies, conflicts, or shortages in area or boundary lines; any encroachments or overlapping of improvements; all rights, obligations, and other matters arising from and existing by reason of any water, utility, road, or improvement districts which affect the


Property; standby fees, taxes, and assessments by any taxing authority for the current year, which Grantee assumes and agrees to pay, and subsequent assessments for that and prior years due to change in land usage, ownership, or both, the payment of which Grantee also assumes.

Grantor, for the Consideration and subject to the Reservations from Conveyance and the Exceptions to Conveyance and Warranty, grants, sells, and conveys to Grantee the Property, together with all and singular the rights and appurtenances thereto in any way belonging, to have and to hold it to Grantee and Grantee's heirs, successors, and assigns forever. Grantor binds Grantor and Grantor's heirs and successors to warrant and forever defend all and singular the Property to Grantee and Grantee's heirs, successors, and assigns against every person whomsoever lawfully claiming or to claim the same or any part thereof, except as to the Reservations from Conveyance and the Exceptions to Conveyance and Warranty.

Limitation of Warranties: Pursuant to Section 7 of the purchase and sale contract between Grantor, as Seller, and Grantee, as Buyer, Grantee accepts the Property "AS IS". "As is" means the present condition of the Property with any and all defects and without warranty except for the warranties of title and the warranties in the purchase and sale contract.

When the context requires, singular nouns and pronouns include the plural.

NOTICE: This instrument was prepared by Hancock McGill & Bleau, LLLP (HMB) at the request of Independence Title or the parties using information provided by the title company and the parties. Unless we have been provided with a copy of any contracts related to this transaction or been informed of any reservations required by the seller, the reservations will not be included in this warranty deed and by accepting this deed, all parties release HMB from any liability resulting from the failure to include undisclosed reservations. We have not investigated or verified information provided to us and do not warrant the validity of the information or quality of title to the real estate described above. **We do not represent the parties named in this instrument. The parties should seek independent legal counsel for advice concerning the effect and consequences of this instrument.**




Mark Harris

State of Texas
County of Guadalupe

This document was acknowledged before me on September 1st, 2021 by Mark Harris.

Jac S. Pickens
Notary Public, State of Texas

Prepared By:
Hancock McGill & Bleau, L.L.L.P.
Attorneys at Law
File No. 2150704-FW

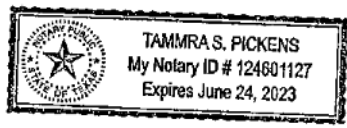

After Recording Return To:

Exhibit "A"

Lot 188, DEER RIVER PHASE 2, situated in Comal County, according to the map or plat thereof, recorded in Volume 8, Pages 359-361, Map and Plat Records, Comal County, Texas.

**Filed and Recorded
Official Public Records
Bobbie Koepf, County Clerk
Comal County, Texas
09/01/2021 03:59:43 PM
CSCHUL 4 Pages(s)
202106046297**



Bobbie Koepf

Luna Environmental

4222 FM 482

New Braunfels, TX 78132

(830) 312-8776

sherrie@lunaenvironmental.com

Printed:9/20/2023

Permit: 113479

Site: 7961 Pronghorn, Spring Branch, TX 78070

Cell Phone: 2108335400

Juan Garcia

7961 Pronghorn

Spring Branch, TX 78070

Agency: Comal County

Subdivision: Deer River

System Info: MFG: Brand:

Customer ID: 8161

Treatment Type: Aerobic

Disposal Type: Spray

Insp ID: 33152

Visit Details

Visit Date: 9/20/2023

Entered By: Ryan Seidensticker

GPS Lat: 29.95269 GPS Long: -98.38387

Scheduled Date: 8/10/2023

Contract Starts: 12/10/2021

Customer Emailed: 9/20/2023

Entered On: 9/20/2023

Contract Ends: 12/10/2023

Visit Results

Service Type: **Scheduled Inspection**

Count: Inspection 5 of 6

Method: **Grab**

License #

Expires

Technician: Ronnie Ransom

0002564

8/31/2026

Provider: Luna Environmental, LLC

Service Completed

Aerators: Operational

Sludge Level Tank 1: 12

Filters: Operational

Irrigation Pumps: Operational

Sludge Level Tank 3: 15

Disinfection Device: Operational

Chlorine Supply: Operational

Chlorine Residual: .1

Electric Circuits: Operational

Tank Lid / Riser: Secured

Distribution System: Operational

Insp. Port / Plug: Secured

Drip/Sprayfield Veg: Operational

Alarm: Operational

PSI Pressure: 1.9

Comments

Scum on pretreatment 2" - Technician Secured the Tank Lid and/or Riser prior to leaving location. - Inspection Port Plug was noted as Secured prior to leaving. - Copy emailed to the customer on 9/20/2023. - The Agency was emailed a PDF Copy on 9/20/2023.