

Comal County Environmental Health

OSSF Inspection Sheet

Installer Name: _____

OSSF Installer #: _____

1st Inspection Date: _____

2nd Inspection Date: _____

3rd Inspection Date: _____

Inspector Name: _____

Inspector Name: _____

Inspector Name: _____

Permit#:

Address:

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
1	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Site and Soil Conditions Consistent with Submitted Planning Materials		285.31(a) 285.30(b)(1)(A)(iv) 285.30(b)(1)(A)(v) 285.30(b)(1)(A)(iii) 285.30(b)(1)(A)(ii) 285.30(b)(1)(A)(i)				
2	SITE AND SOIL CONDITIONS & SETBACK DISTANCES Setback Distances Meet Minimum Standards		285.91(10) 285.30(b)(4) 285.31(d)				
3	SEWER PIPE Proper Type Pipe from Structure to Disposal System (Cast Iron, Ductile Iron, Sch. 40, SDR 26)		285.32(a)(1)				
4	SEWER PIPE Slope from the Sewer to the Tank at least 1/8 Inch Per Foot		285.32(a)(3)				
5	SEWER PIPE Two Way Sanitary - Type Cleanout Properly Installed (Add. C/O Every 100' &/or 90 degree bends)		285.32(a)(5)				
6	PRETREATMENT Installed (if required) TCEQ Approved List PRETREATMENT Septic Tank(s) Meet Minimum Requirements		285.32(b)(1)(G) 285.32(b)(1)(E)(iii) 285.32(b)(1)(E)(iv) 285.32(b)(1)(F) 285.32(b)(1)(B) 285.32(b)(1)(C)(i) 285.32(b)(1)(C)(ii) 285.32(b)(1)(D) 285.32(b)(1)(E) 285.32(b)(1)(A) 285.32(b)(1)(E)(ii)(II) 285.32(b)(1)(E)(i) 285.32(b)(1)(E)(ii)(I)				
7	PRETREATMENT Grease Interceptors if required for commercial		285.34(d)				

Inspector Notes:

**Comal County Environmental Health
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
8	SEPTIC TANK Tank(s) Clearly Marked SEPTIC TANK If Single Tank, 2 Compartments Provided with Baffle SEPTIC TANK Inlet Flowline Greater than 3" and " T " Provided on Inlet and Outlet SEPTIC TANK Septic Tank(s) Meet Minimum Requirements		285.32(b)(1) (E) 285.91(2) 285.32(b)(1) (F) 285.32(b)(1)(E) (iii) 285.32(b)(1)(E)(ii) (II) 285.32(b)(1)(E)(ii) (I) 285.32(b)(1)(E) (i) 285.32(b)(1) (D) 285.32(b)(1)(C) (ii) 285.32(b)(1)(C) (i) 285.32(b)(1) (B) 285.32(b)(1) (A) 285.32(b)(1)(E)(iv)				
9	ALL TANKS Installed on 4" Sand Cushion/ Proper Backfill Used		285.32(b)(1)(F) 285.32(b)(1)(G) 285.34(b)				
10	SEPTIC TANK Inspection / Clean Out Port & Risers Provided on Tanks Buried Greater than 12" Sealed and Capped		285.38(d)				
11	SEPTIC TANK Secondary restraint system provided SEPTIC TANK Riser permanently fastened to lid or cast into tank SEPTIC TANK Riser cap protected against unauthorized intrusions		285.38(d) 285.38(e)				
12	SEPTIC TANK Tank Volume Installed						
13	PUMP TANK Volume Installed						
14	AEROBIC TREATMENT UNIT Size Installed						
15	AEROBIC TREATMENT UNIT Manufacturer AEROBIC TREATMENT UNIT Model Number						
16	DISPOSAL SYSTEM Absorptive		285.33(a)(4) 285.33(a)(1) 285.33(a)(2) 285.33(a)(3)				
17	DISPOSAL SYSTEM Leaching Chamber		285.33(a)(1) 285.33(a)(3) 285.33(a)(4) 285.33(a)(2)				
18	DISPOSAL SYSTEM Evapo-transpirative		285.33(a)(3) 285.33(a)(4) 285.33(a)(1) 285.33(a)(2)				

**Comal County Environmental Health
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
19	DISPOSAL SYSTEM Drip Irrigation		285.33(c)(3)(A)-(F)				
20	DISPOSAL SYSTEM Soil Substitution		285.33(d)(4)				
21	DISPOSAL SYSTEM Pumped Effluent		285.33(a)(4) 285.33(a)(3) 285.33(a)(1) 285.33(a)(2)				
22	DISPOSAL SYSTEM Gravelless Pipe		285.33(a)(3) 285.33(a)(2) 285.33(a)(4) 285.33(a)(1)				
23	DISPOSAL SYSTEM Mound		285.33(a)(3) 285.33(a)(1) 285.33(a)(2) 285.33(a)(4)				
24	DISPOSAL SYSTEM Other (describe) (Approved Design)		285.33(d)(6) 285.33(c)(4)				
25	DRAINFIELD Absorptive Drainline 3" PVC or 4" PVC						
26	DRAINFIELD Area Installed						
27	DRAINFIELD Level to within 1 inch per 25 feet and within 3 inches over entire excavation		285.33(b)(1)(A)(v)				
28	DRAINFIELD Excavation Width DRAINFIELD Excavation Depth DRAINFIELD Excavation Separation DRAINFIELD Depth of Porous Media DRAINFIELD Type of Porous Media						
29	DRAINFIELD Pipe and Gravel - Geotextile Fabric in Place		285.33(b)(1)(E)				
30	DRAINFIELD Leaching Chambers DRAINFIELD Chambers - Open End Plates w/Splash Plate, Inspection Port & Closed End Plates in Place (per manufacturers spec.)		285.33(c)(2)				
31	LOW PRESSURE DISPOSAL SYSTEM Adequate Trench Length & Width, and Adequate Separation Distance between Trenches		285.33(d)(1)(C)(i)				

**Comal County Environmental Health
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
32	EFFLUENT DISPOSAL SYSTEM Utilized Only by Single Family Dwelling EFFLUENT DISPOSAL SYSTEM Topographic Slopes < 2.0% EFFLUENT DISPOSAL SYSTEM Adequate Length of Drain Field (1000 Linear ft. for 2 bedrooms or Less & an additional 400 ft. for each additional bedroom) EFFLUENT DISPOSAL SYSTEM Lateral Depth of 18 inches to 3 ft. & Vertical Separation of 1ft on bottom and 2 ft. to restrictive horizon and ground water respectfully EFFLUENT DISPOSAL SYSTEM Lateral Drain Pipe (1.25 - 1.5" dia.) & Pipe Holes (3/16 - 1/4" dia. Hole Size) 5 ft. Apart		285.33(b)(3)(A) 285.33(b)(3)(A) 285.33(b)(3)(B)285.91(13) 285.33(b)(3)(D) 285.33(b)(3)(F)				
33	AEROBIC TREATMENT UNIT Is Aerobic Unit Installed According to Approved Guidelines.		285.32(c)(1)				
34	AEROBIC TREATMENT UNIT Inspection/Clean Out Port & Risers Provided AEROBIC TREATMENT UNIT Secondary restraint system provided AEROBIC TREATMENT UNIT Riser permanently fastened to lid or cast into tank AEROBIC TREATMENT UNIT Riser cap protected against unauthorized intrusions						
35	AEROBIC TREATMENT UNIT Chlorinator Properly Installed with Chlorine Tablets in Place.						
36	PUMP TANK Is the Pump Tank an approved concrete tank or other acceptable materials & construction PUMP TANK Sampling Port Provided in the Treated Effluent Line PUMP TANK Check Valve and/or Anti- Siphon Device Present When Required PUMP TANK Audible and Visual High Water Alarm Installed on Separate Circuit From Pump						
37	PUMP TANK Inspection/Clean Out Port & Risers Provided PUMP TANK Secondary restraint system provided PUMP TANK Riser permanently fastened to lid or cast into tank PUMP TANK Riser cap protected against unauthorized intrusions						
38	PUMP TANK Secondary restraint system provided						
39	PUMP TANK Electrical Connections in Approved Junction Boxes / Wiring Buried						

**Comal County Environmental Health
OSSF Inspection Sheet**

No.	Description	Answer	Citations	Notes	1st Insp.	2nd Insp.	3rd Insp.
40	APPLICATION AREA Distribution Pipe, Fitting, Sprinkler Heads & Valve Covers Color Coded Purple?		285.33(d)(2)(G)(iii)(II) 285.33(d)(2)(G)(iii)(III) 285.33(d)(2)(G)(v) 285.33(d)(2)(G)(iii) 285.33(d)(2)(G)(iv) 285.33(d)(2)(G)(i) 285.33(d)(2)(G)(ii) 285.33(d)(2)(G)(iii)(I)				
41	APPLICATION AREA Low Angle Nozzles Used / Pressure is as required APPLICATION AREA Acceptable Area, nothing within 10 ft of sprinkler heads? APPLICATION AREA The Landscape Plan is as Designed		285.33(d)(2)(G) (i)285.33(d)(2) (A)285.33(d)(2)(F)				
42	APPLICATION AREA Area Installed						
43	PUMP TANK Meets Minimum Reserve Capacity Requirements						
44	PUMP TANK Material Type & Manufacturer						
45	PUMP TANK Type/Size of Pump Installed						



COMAL COUNTY

ENGINEER'S OFFICE

Permit of Authorization to Construct an On-Site Sewage Facility Permit Valid For One Year From Date Issued

Permit Number: 118633
Issued This Date: 05/30/2025
This permit is hereby given to: BARRY & JANE BUCHANAN

To start construction of a private, on-site sewage facility located at:

1012 EDEN ESTATES DR
NEW BRAUNFELS, TX 78132

Subdivision: EDEN RANCH
Unit: 8
Lot: 13
Block: 0
Acreage: 5.0100

APPROVED MINIMUM SIZES AS PER ATTACHED DESIGN

Type of System: Aerobic
Surface Irrigation

This permit gives permission for the construction of the above referenced on-site facility to commence. Installation must be completed by an installer holding a valid registration card from the Texas Commission on Environmental Quality (TCEQ). Installation and inspection must comply with current TCEQ and Comal County requirements.

Call (830) 608-2090 to schedule inspections.



COMAL COUNTY
ENGINEER'S OFFICE

ON-SITE SEWAGE FACILITY APPLICATION

195 DAVID JONAS DR
NEW BRAUNFELS, TX 78132
(830) 608-2090
WWW.CCEO.ORG

Date 03/31/25

Permit Number 118633

1. APPLICANT / AGENT INFORMATION

Owner Name Barry & Jane Buchanan
Mailing Address c/o 23011 FM 306
City, State, Zip Canyon Lake, TX 78133
Phone # 830-935-4936
Email traci@psseptics.com

Agent Name GREG W. JOHNSON, P.E.
Agent Address 170 Hollow Oak
City, State, Zip New Braunfels, TX 78132
Phone # 830-905-2778
Email gregjohnsonpe@yahoo.com

2. LOCATION

Subdivision Name EDEN RANCH Unit 8 Lot 13 Block
Survey Name / Abstract Number 160145-8 Acreage
Address 1012 EDEN ESTATES DR City NEW BRAUNFELS State TX Zip 78132

3. TYPE OF DEVELOPMENT

☒ Single Family Residential

Type of Construction (House, Mobile, RV, Etc.) HOUSE + Personal RV (Intermittent Use)

Number of Bedrooms 3

Indicate Sq Ft of Living Area 1292

☐ Non-Single Family Residential

(Planning materials must show adequate land area for doubling the required land needed for treatment units and disposal area)

Type of Facility

Offices, Factories, Churches, Schools, Parks, Etc. - Indicate Number Of Occupants

Restaurants, Lounges, Theaters - Indicate Number of Seats

Hotel, Motel, Hospital, Nursing Home - Indicate Number of Beds

Travel Trailer/RV Parks - Indicate Number of Spaces

Miscellaneous

Estimated Cost of Construction: \$ EXISTING (Structure Only)

Is any portion of the proposed OSSF located in the United States Army Corps of Engineers (USACE) flowage easement?

☐ Yes ☒ No (If yes, owner must provide approval from USACE for proposed OSSF improvements within the USACE flowage easement)

Source of Water ☐ Public ☒ Private Well

4. SIGNATURE OF OWNER

By signing this application, I certify that:

- The completed application and all additional information submitted does not contain any false information and does not conceal any material facts. I certify that I am the property owner or I possess the appropriate land rights necessary to make the permitted improvements on said property.
- Authorization is hereby given to the permitting authority and designated agents to enter upon the above described property for the purpose of site/soil evaluation and inspection of private sewage facilities..
- I understand that a permit of authorization to construct will not be issued until the Floodplain Administrator has performed the reviews required by the Comal County Flood Damage Prevention Order.
- I affirmatively consent to the online posting/public release of my e-mail address associated with this permit application, as applicable.

Barry Buchanan
Jane Buchanan

4-1-25
4/1/25



COMAL COUNTY
ENGINEER'S OFFICE

ON-SITE SEWAGE FACILITY APPLICATION

195 DAVID JONAS DR
NEW BRAUNFELS, TX 78132
(830) 608-2090
WWW.CCEO.ORG

Planning Materials & Site Evaluation as Required Completed By GREG W. JOHNSON, P.E.

System Description PROPRIETARY; AEROBIC TREATMENT AND SURFACE IRRIGATION

Size of Septic System Required Based on Planning Materials & Soil Evaluation

Tank Size(s) (Gallons) MAXX AIR M600 Absorption/Application Area (Sq Ft) 4926

Gallons Per Day (As Per TCEQ Table III) 280

(Sites generating more than 5000 gallons per day are required to obtain a permit through TCEQ)

Is the property located over the Edwards Recharge Zone? ☒ Yes ☐ No

(If yes, the planning materials must be completed by a Registered Sanitarian (R.S.) or Professional Engineer (P.E.))

Is there an existing TCEQ approved WPAP for the property? ☐ Yes ☒ No

(if yes, the R. S. or P. E. shall certify that the OSSF design complies with all provisions of the existing WPAP.)

Is there at least one acre per single family dwelling as per 285.40(c)(1)? ☒ Yes ☐ No

If there is no existing WPAP, does the proposed development activity require a TCEQ approved WPAP? ☐ Yes ☒ No

(If yes, the R.S. or P. E. shall certify that the OSSF design will comply with all provisions of the proposed WPAP. A Permit to Construct will not be issued for the proposed OSSF until the proposed WPAP has been approved by the appropriate regional office.)

Is the property located over the Edwards Contributing Zone? ☐ Yes ☒ No

Is there an existing TCEQ approval CZP for the property? ☐ Yes ☒ No

(if yes, the P.E. or R.S. shall certify that the OSSF design complies with all provisions of the existing CZP)

If there is no existing CZP, does the proposed development activity require a TCEQ approved CZP? ☐ Yes ☒ No

(if yes, the P.E. or R.S. shall certify that the OSSF design will comply with all provisions of the proposed CZP. A Permit to construct will not be issued for the proposed OSSF until the CZP has been approved by the app

Is this property within an incorporated city? ☐ Yes ☒ No


If yes, indicate the city: _____



FIRM #2585

By signing this application, I certify that:

- The information provided above is true and correct to the best of my knowledge.
- I affirmatively consent to the online posting/public release of my e-mail address associated with this permit application, as applicable


Signature of Designer

April 8, 2025
Date

AFFIDAVIT**THE COUNTY OF COMAL
STATE OF TEXAS****CERTIFICATION OF OSSF REQUIRING MAINTENANCE**

According to Texas Commission on Environmental Quality Rules for On-Site Sewage Facilities (OSSF's), this document is filed in the Deed Records of Comal County, Texas.

I

The Texas Health and Safety Code, Chapter 366 authorizes the Texas Commission on Environmental Quality (TCEQ) to regulate on-site sewage facilities (OSSFs). Additionally, the Texas Water Code (TWC), § 5.012 and § 5.013, gives the commission primary responsibility for implementing the laws of the State of Texas relating to water and adopting rules necessary to carry out its powers and duties under the TWC. The commission, under the authority of the TWC and the Texas Health and Safety code, requires owner's to provide notice to the public that certain types of OSSFs are located on specific pieces of property. To achieve this notice, the commission requires a recorded affidavit. Additionally, the owner must provide proof of the recording to the OSSF permitting authority. This recorded affidavit is not a representation or warranty by the commission of the suitability of this OSSF, nor does it constitute any guarantee by the commission that the appropriate OSSF was installed.

II

An OSSF requiring a maintenance contract, according to 30 Texas Administrative Code §285.91(12) will be installed on the property described as (insert legal description):

8 UNIT/PHASE/SECTION BLOCK 13 LOT Eden Ranch SUBDIVISION

IF NOT IN SUBDIVISION: ACREAGE SURVEY

The property is owned by (insert owner's full name): Barry & Jane Buchanan

This OSSF must be covered by a continuous maintenance contract for the first two years. After the initial two-year service policy, the owner of an aerobic treatment system for a single family residence shall either obtain a maintenance contract within 30 days or maintain the system personally.

Upon sale or transfer of the above-described property, the permit for the OSSF shall be transferred to the buyer or new owner. A copy of the planning materials for the OSSF can be obtained from the Comal County Engineer's Office.

WITNESS BY HAND(S) ON THIS 1st DAY OF April, 2025

Jane Buchanan
Barry Buchanan

Jane Buchanan

Barry Buchanan

Owner(s) signature(s)


Owner (s) Printed name (s)

Whitten
April, 2025

SWORN TO AND SUBSCRIBED BEFORE ME ON THIS 1st DAY OF

THIS AREA FOR COMAL COUNTY CLERK RECORDING PURPOSES ONLY

Notary Public Signature

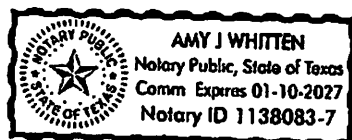

(Notary Seal Here)

**Filed and Recorded
Official Public Records
Bobbie Koepf, County Clerk
Comal County, Texas
04/01/2025 11:29:04 AM
TAMMY 1 Pages(s)
202506009233**



Bobbie Koepf

**THE COUNTY OF COMAL
STATE OF TEXAS**

CERTIFICATION OF SINGLE FAMILY DWELLING

According to Texas Commission of Environmental Quality Rules for On-Site Sewage Facilities, this document is filed in the Deed Records of COMAL COUNTY, TEXAS.

1

Before me this day appeared BARRY & JANE BUCHANAN, being the owners of the referenced property at 1012 EDEN ESTATES DRIVE. They further state that the Residence and any additional living space on this property will be occupied only by a single family.

An OSSF requiring a Certification of Single Family Dwelling, will be installed on the property described as:

8 SECT BLOCK 13 LOT EDEN RANCH SUBDIVISION

IF NOT IN SUBDIVISION: ACREAGE SURVEY

The property is owned by BARRY BUCHANAN & JANE BUCHANAN

WITNESS MY HAND ON THIS 8th OF DAY OF April, 20 25.

Jane Buchanan
OWNER (SIGNATURE)


x Barry Buchanan
OWNER (SIGNATURE)

SWORN TO AND SUBSCRIBED BEFORE ME ON THIS 8th DAY OF April, 20 25 BY

BARRY BUCHANAN
OWNER NAME (PRINTED)

JANE BUCHANAN
OWNER NAME (PRINTED)

Amy J Whitten
Notary Public Signature

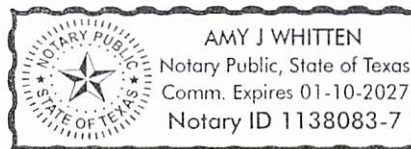

REVISED

10:44 am, May 30, 2025



By Cody Young LLC

To: Barry & Jane Buchanan

Site: 1012 Eden Estates Dr, New Braunfels, TX 78132

County: Comal

Installer: Paul Swoyer Septics

Agency: _____

Mfg./Brand: _____

Level 1 Contract

This service contract for the On-Site Sewage-facility, (OSSF), located at the site stated above. OSSF is to be inspected and serviced at regular intervals under a licensed provider. Special emergency service is to be provided within 48 hours of notification by the homeowner or the owner's agent. The initial contract is for (2) years from the date of final septic system inspection. Renewals shall be for a period of 2 years at the current rate and remain in effect for the specified dates listed. From FROM DATE OF until 2 YEARS FROM LTO
LICENSE TO OPERATE

Contract price \$700

Service Program Includes:

1. Regular site inspection at 4-month intervals for residential septic system.
2. OSSF maintenance: check aerator components for proper operation, control panel, effluent pump, spray head/drip nozzle. Check Proprietary specific components. Check pumps, check spray heads, check, and clean any Filters, check bull run valves and any other valves. Flush drain field if needed.
3. Visual inspection of control panel, (when accessible).
4. Labor expenses required at the home to maintain, repair, or remove any part of the control center or mechanical aerator to be returned for factory repair.
5. Labor expenses required at the home to service, repair, or install any part of the control panel or aerator returned from factory.
6. All maintenance reports will be emailed to the permitting authority & customer within 14 days of inspection.

REVISED

10:45 am, May 30, 2025

Client Responsibilities:

1. Special service calls after the (at the 4-month intervals) stated in item #1.
2. BODs or TSS grab samples, (if needed).
3. Freight costs to and from factory, for component repair.
4. Costs for replacing damaged or missing parts and repairing any equipment not under any specified warranty.
5. Pumping out any or all the OSSF by a licensed waste hauler.
6. The Homeowner is responsible for maintaining the chlorinator and providing proper chlorine supply if required.
7. Securing pets so that maintenance functions can be performed safely for the technician, and the pet. If pets are present in the yard, and the owner is not on site to secure the animals, it is necessary to cancel the maintenance.
8. Securing pets so that maintenance functions can be performed safely for the technician, and the pet. If pets are present in the yard, and the owner is not on site to secure the animals, and it is necessary to cancel the maintenance, there will be a \$75 trip charge.
9. Insuring access to the property, always to the maintenance provider. (Gates, chains with locks, codes, etc.)


Miscellaneous Provisions

1. This contract can be terminated by either party in writing, within 30 days' notice. Contracts that are terminated will include notification in writing to the Authority having Jurisdiction, the Manufacturer of the system, and the other party.

Homeowner: Barry Buchanan Date: 4-1-25

Phone: 830-312-9692 Email: BUCHANANBARRY65@AOL.COM

Maintenance Provider: Milo Young, License #MP0002338



Septic Pumping & Maintenance by Cody Young

911 RR3404

Kingsland, TX 78639

(325)248-8740

Greg W. Johnson, P.E.
170 Hollow Oak
New Braunfels, Texas 78132
830/905-2778

April 08, 2025

Comal County Office of Environmental Health
195 David Jonas Drive
New Braunfels, Texas 78132-3760


RE- SEPTIC DESIGN
1012 EDEN ESTATES DRIVE
EDEN RANCH, SECTION 8, LOT 13
NEW BRAUNFELS, TX 78132
BUCHANAN RESIDENCE

Ms. Brenda Ritzen/ Brandon,


The referenced property is located within the Edwards Aquifer Recharge Zone. This property is exempt from a WPAP because it is not a regulated activity according to §213.3(28)(B)(v). To my knowledge no WPAP exists for this property.

Temporary erosion and sedimentation controls should be utilized as necessary prior to construction. If any sensitive feature (caves, solution cavities, sink holes, etc.) is discovered during construction, activities must be suspended immediately and the applicant or his agent must immediately notify the TCEQ Regional Office. After that operations can only proceed after the Executive Director approves required additional engineered impact plans.

Designed in accordance with Chapter 285, Subchapter D, §285.40, 285.41, & 285.42, Texas Commission on Environmental Quality (Effective December 29, 2016).

 04/08/25

Greg W. Johnson, P.E. No. 67587/F#2585
170 Hollow Oak
New Braunfels, Texas 78132 - 830/905-2778

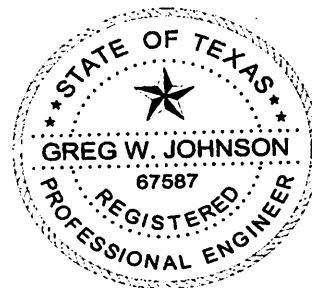

ON-SITE SEWERAGE FACILITY SOIL EVALUATION REPORT INFORMATION

Date Soil Survey Performed: April 07, 2025

Site Location: EDEN RANCH, SECTION 8, LOT 13

Proposed Excavation Depth: N/A


Requirements:

At least two soil excavations must be performed on the site, at opposite ends of the proposed disposal area.
Locations of soil boring or dug pits must be shown on the site drawing.
For subsurface disposal, soil evaluations must be performed to a depth of at least two feet below the proposed excavation depth. For surface disposal, the surface horizon must be evaluated.
Describe each soil horizon and identify any restrictive features on the form. Indicate depths where features appear.

SOIL BORING NUMBER <u> </u> SURFACE EVALUATION						
Depth (Feet)	Texture Class	Soil Texture	Gravel Analysis	Drainage (Mottles/ Water Table)	Restrictive Horizon	Observations
0	III	CLAY LOAM	N/A	NONE OBSERVED	LIMESTONE @ 10"	BROWN STONY
10"						
1						
2						
3						
4						
5						

SOIL BORING NUMBER <u> </u> SURFACE EVALUATION						
Depth (Feet)	Texture Class	Soil Texture	Gravel Analysis	Drainage (Mottles/ Water Table)	Restrictive Horizon	Observations
0	SAME		AS		ABOVE	
1						
2						
3						
4						
5						


I certify that the findings of this report are based on my field observations and are accurate to the best of my ability.

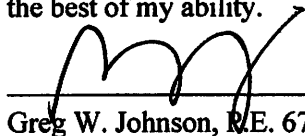
Greg W. Johnson, R.E. 67587-F2585, S.E. 11561

04/07/25
Date

FIRM #2585

NOTE:
EXISTING SEPTIC
TANK TO BE
PUMPED, CRUSHED
AND BACK FILLED.
EXISTING SEPTIC
SYSTEM TO BE
ABANDONED

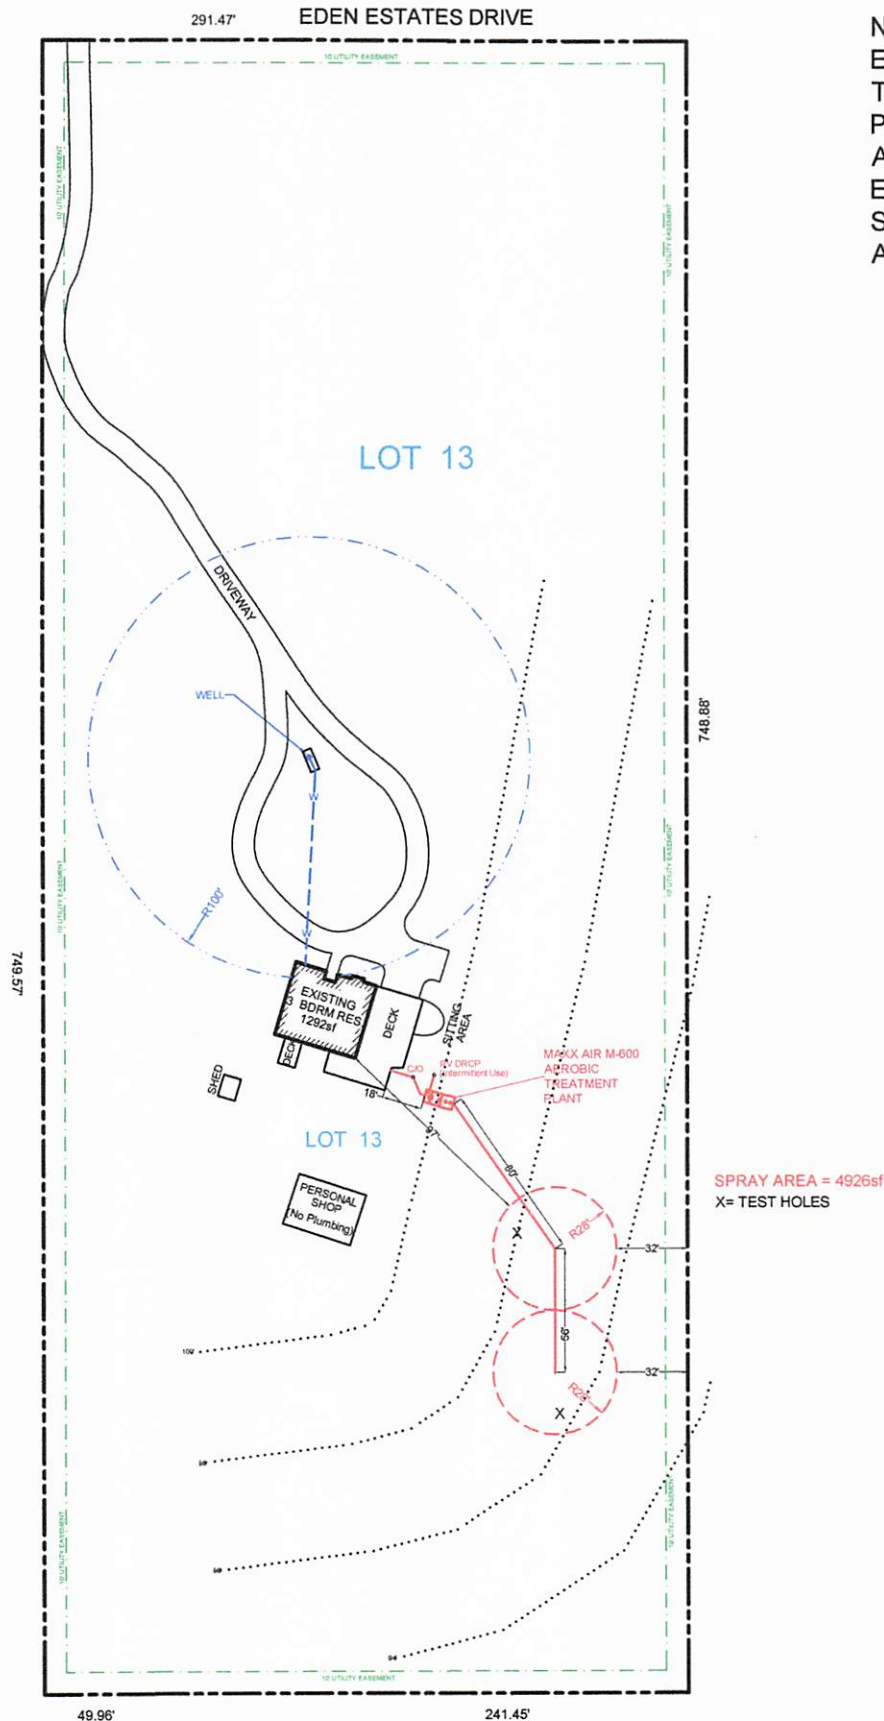

OWNER: BARRY & JANE BUCHANAN				DRAWN BY: EJS III	
STREET ADDRESS: 1012 EDEN ESTATES DRIVE					
LEGAL DESC: EDEN RANCH			UNIT/SECTION/PHASE: 8	BLOCK:	LOT: 13
PREPARED BY: GREG W. JOHNSON, P.E. F#002585		SCALE: N.T.S.	DATE: 4/8/2025		REVISED:

NOTE:
EXISTING SEPTIC
TANK TO BE
PUMPED, CRUSHED
AND BACK FILLED.
EXISTING SEPTIC
SYSTEM TO BE
ABANDONED

WELL

R100'

EXISTING
BDRM RES
1292sf

DECK

SITTING
AREA

SHED

LOT 13

PERSONAL
SHOP
(No Plumbing)

C/O

R.V. DROP
(Intermittent Use)

MAXX AIR M-600
AEROBIC
TREATMENT
PLANT

748.88'

10' UTILITY EASEMENT

SPRAY AREA = 4926sf
X= TEST HOLES

X

R28'

56'

X

R28'

32'

32'

10' UTILITY EASEMENT




OWNER: BARRY & JANE BUCHANAN		DRAWN BY: EJS III	
STREET ADDRESS: 1012 EDEN ESTATES DRIVE			
LEGAL DESC: EDEN RANCH	UNIT/SECTION/PHASE: 8	BLOCK:	LOT: 13
PREPARED BY: GREG W. JOHNSON, P.E. F#002585	SCALE: 1"=50'	DATE: 4/8/2025	REVISED:



GENERAL NOTES:

1. Plant structure material to be precast concrete and steel.
2. Weight = 14,900 lbs.
3. Treatment capacity is 600 GPD. BOD Loading = 1.62 lbs. per day.
4. Standard tablet chlorinator or Optional Liquid chlorinator. NSF approved chlorinators (tablet & liquid) available.
5. Control Center w/ Timer for night spray application.
7. 20" Ø access riser w/ lid (Typical 4). Optional extension risers available.
8. 20 GPM 1/2 HP, high head effluent pump.
9. Air Compressor w/ concrete housing.
10. 1/2" Sch. 40 PVC Air Line (Max. 50 Lft from Plant).
11. 1" Sch. 40 PVC pipe to distribution system provided by contractor.

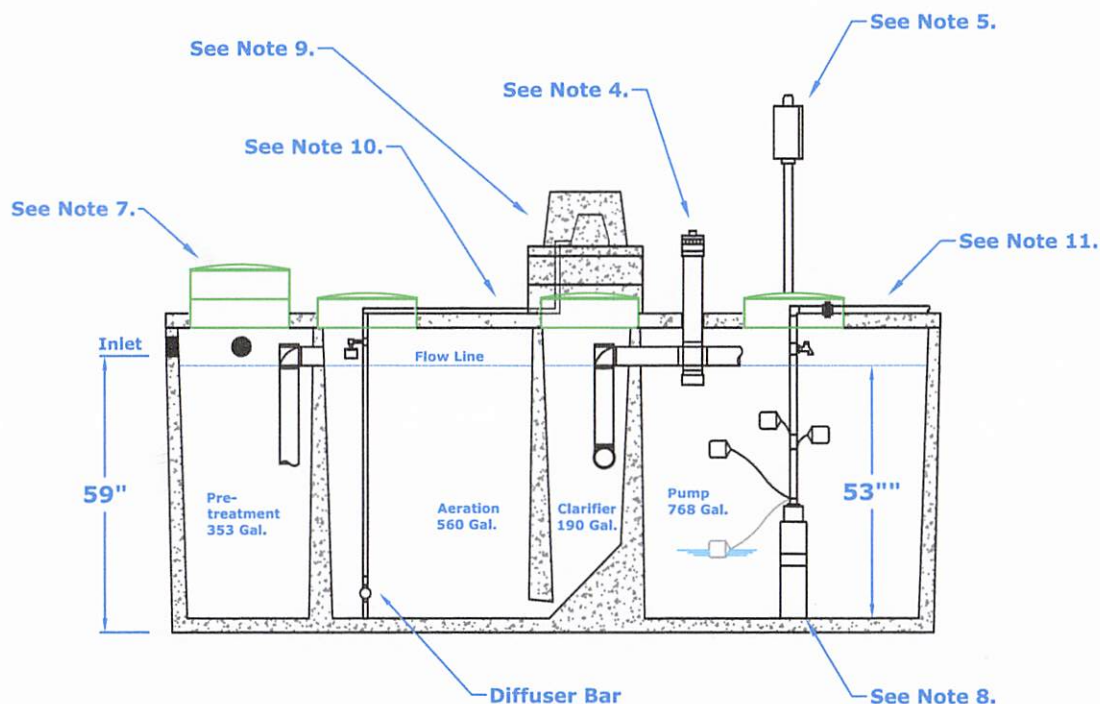

DIMENSIONS:

Outside Height: 67"
Outside Width: 63"
Outside Length: 164"

MINIMUM EXCAVATION DIMENSIONS:

Width: 76"
Length: 176"



Maxx Air M-600 (600 GPD) Aerobic Treatment Plant (Assembled)

Dec, 2013
By: A.S.

Scale:
* All Dimensions subject to allowable specification
tolerances.

Dwg. #: ADV-B550-3

Advantage
Wastewater Solutions LLC

Advantage Wastewater Solutions LLC.
444 A Old Hwy No 9
Comfort, TX 78013
830-995-3189
fax 830-995-4051


TANK NOTES:

Tanks must be set to allow a minimum of 1/8" per foot fall from the residence.

Tightlines to the tank shall be SCH-40 PVC.

A two way sanitary tee is required between residence and tank.

A minimum of 4" of sand, sandy loam, clay loam free of rock shall be placed under and around tanks

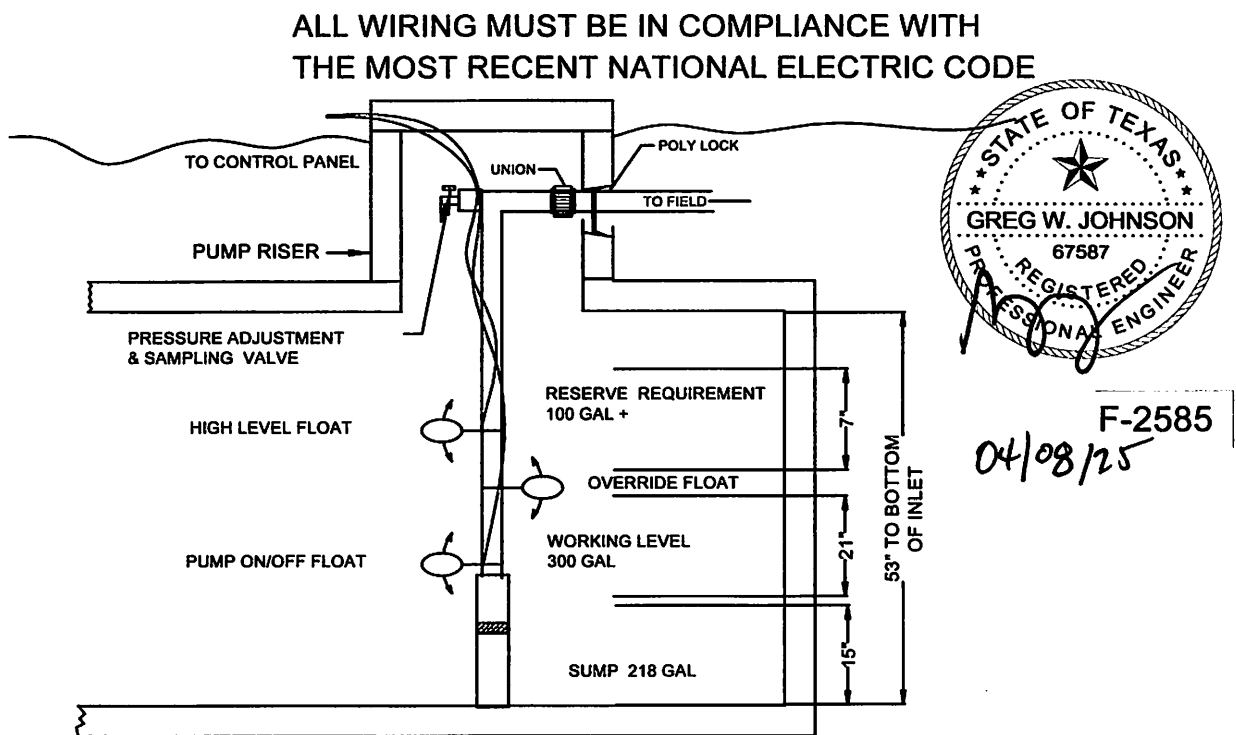

**TYPICAL PUMP TANK CONFIGURATION
MAXX AIR M600 768 GAL PUMP TANK**

CISTERN PUMPS

CPM Series

Ashland Pump – CPM Series

The Ashland Pump CPM Series is designed to operate in filtered effluent/gray water applications. The bottom suction design allows for maximum drawdown of fluid and the hydraulic stages are able to pass 1/8" solids without damage to the pump.

Installations in cistern tanks, rain basin catchments or anywhere drawdown levels need to be maximized are ideal applications for the Ashland Pump CPM Series.

APPLICATIONS


- Filtered Effluent Water Pumping
- Gray Water Pumping
- Water Feature / Aeration Applications
- Rain Water Basin Applications

FEATURES


- Bottom suction design for maximum drawdown
- Able to pass 1/8" solids
- Available in 10, 20 and 30 GPM flow rates
- 1/2 HP, 115V and 230V single phase motors
- Heavy duty discharge with stainless steel internal threads
- 600 Volt, 10' SJ00W jacketed lead
- High shut-off pressure
- Quiet operation
- Standard removable base for stable mounting

ORDERING INFORMATION

CPM SERIES CISTERN PUMP						
Model/Order No.	GPM	HP	Voltage/Ph.	Stage Count	Length (in.)	Shipping Wt. (lbs.)
10CPM5-115	10	1/2	115/1	7	26	17
10CPM5-230	10		230/1	7	26	17
20CPM5-115	20		115/1	5	25	16
20CPM5-230	20		230/1	5	25	16
20+CPM5-115	20+		115/1	6	26	17
20+CPM5-230	20+		230/1	6	26	17
30CPM5-115	30		115/1	4	25	16
30CPM5-230	30		230/1	4	25	16

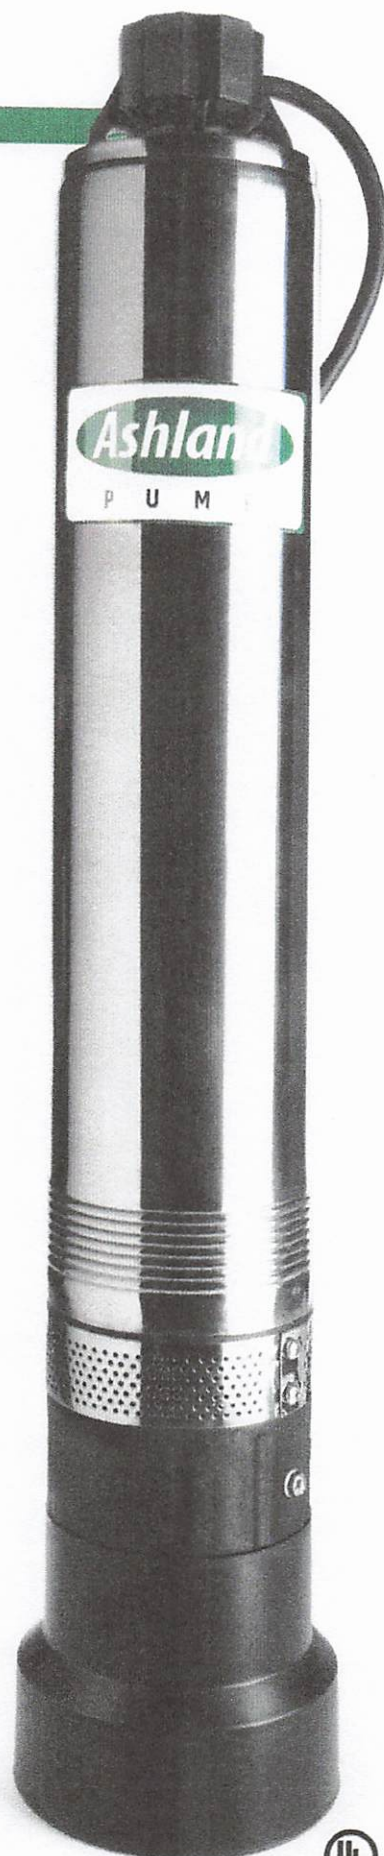

ASHLAND PUMP CPM SERIES CISTERN PUMP PERFORMANCE

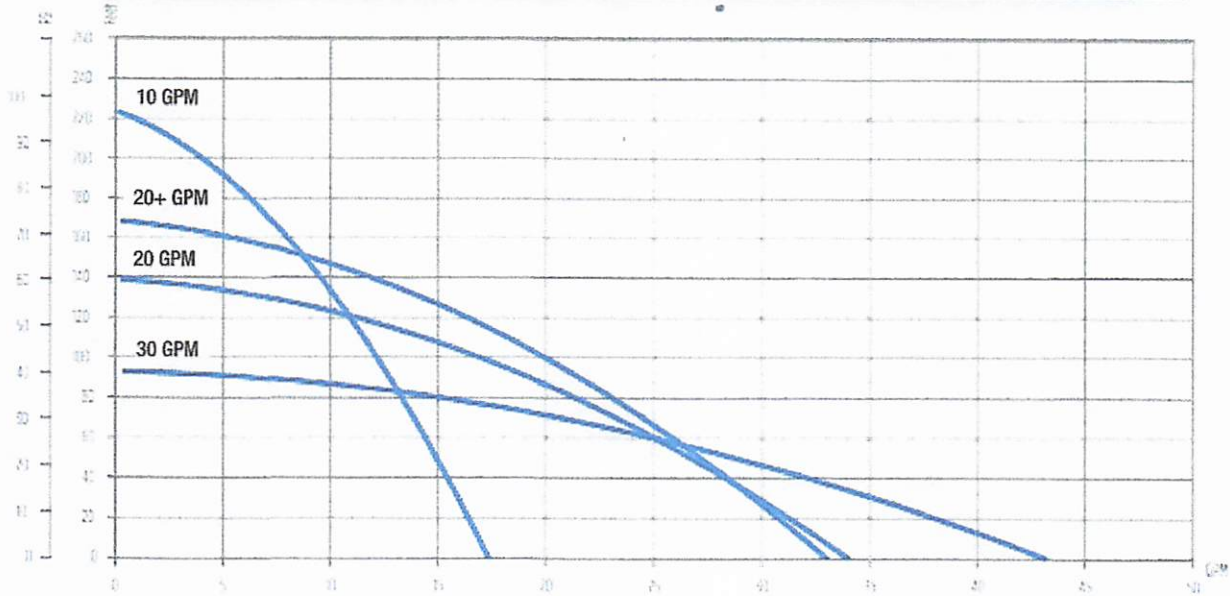

Low Angle Performance Data

NOZZLE	PRESSURE			RADIUS		FLOW RATE		
	PSI	kPa	Bars	Ft.	M.	GPM	L/M	M ³ /H
#1.0	30	207	2.1	22	6.7	1.2	4.5	.27
	40	276	2.8	24	7.3	1.7	6.4	.39
	50	345	3.4	26	7.9	1.8	6.8	.41
	60	414	4.1	28	8.5	2.0	7.6	.45
#3.0	30	207	2.1	29	8.8	3.0	11.4	.68
	40	276	2.8	32	9.8	3.1	11.7	.70
	50	345	3.4	35	10.7	3.5	13.2	.80
	60	414	4.1	37	11.3	3.8	14.4	.86
#4.0	30	207	2.1	31	9.4	3.4	12.9	.77
	40	276	2.8	34	10.4	3.9	14.8	.89
	50	345	3.4	37	11.3	4.4	16.7	1.00
	60	414	4.1	38	11.6	4.7	17.8	1.07
#6.0	40	275	2.8	38	11.6	6.5	24.6	1.48
	50	344	3.4	40	12.2	7.3	27.7	1.66
	60	413	4.1	42	12.8	8.0	30.3	1.82
	70	482	4.8	44	13.4	8.6	32.6	1.96

*All precipitation rates calculated for 180° operation. For the precipitation rate for a 36

K
RAIN




P U M P

Honest, Professional, Dependable

1899 Cottage Street, Ashland, Ohio 44805

Telephone: 855 281-6830 • Fax: 877 326-1994 • ashlandpump.com

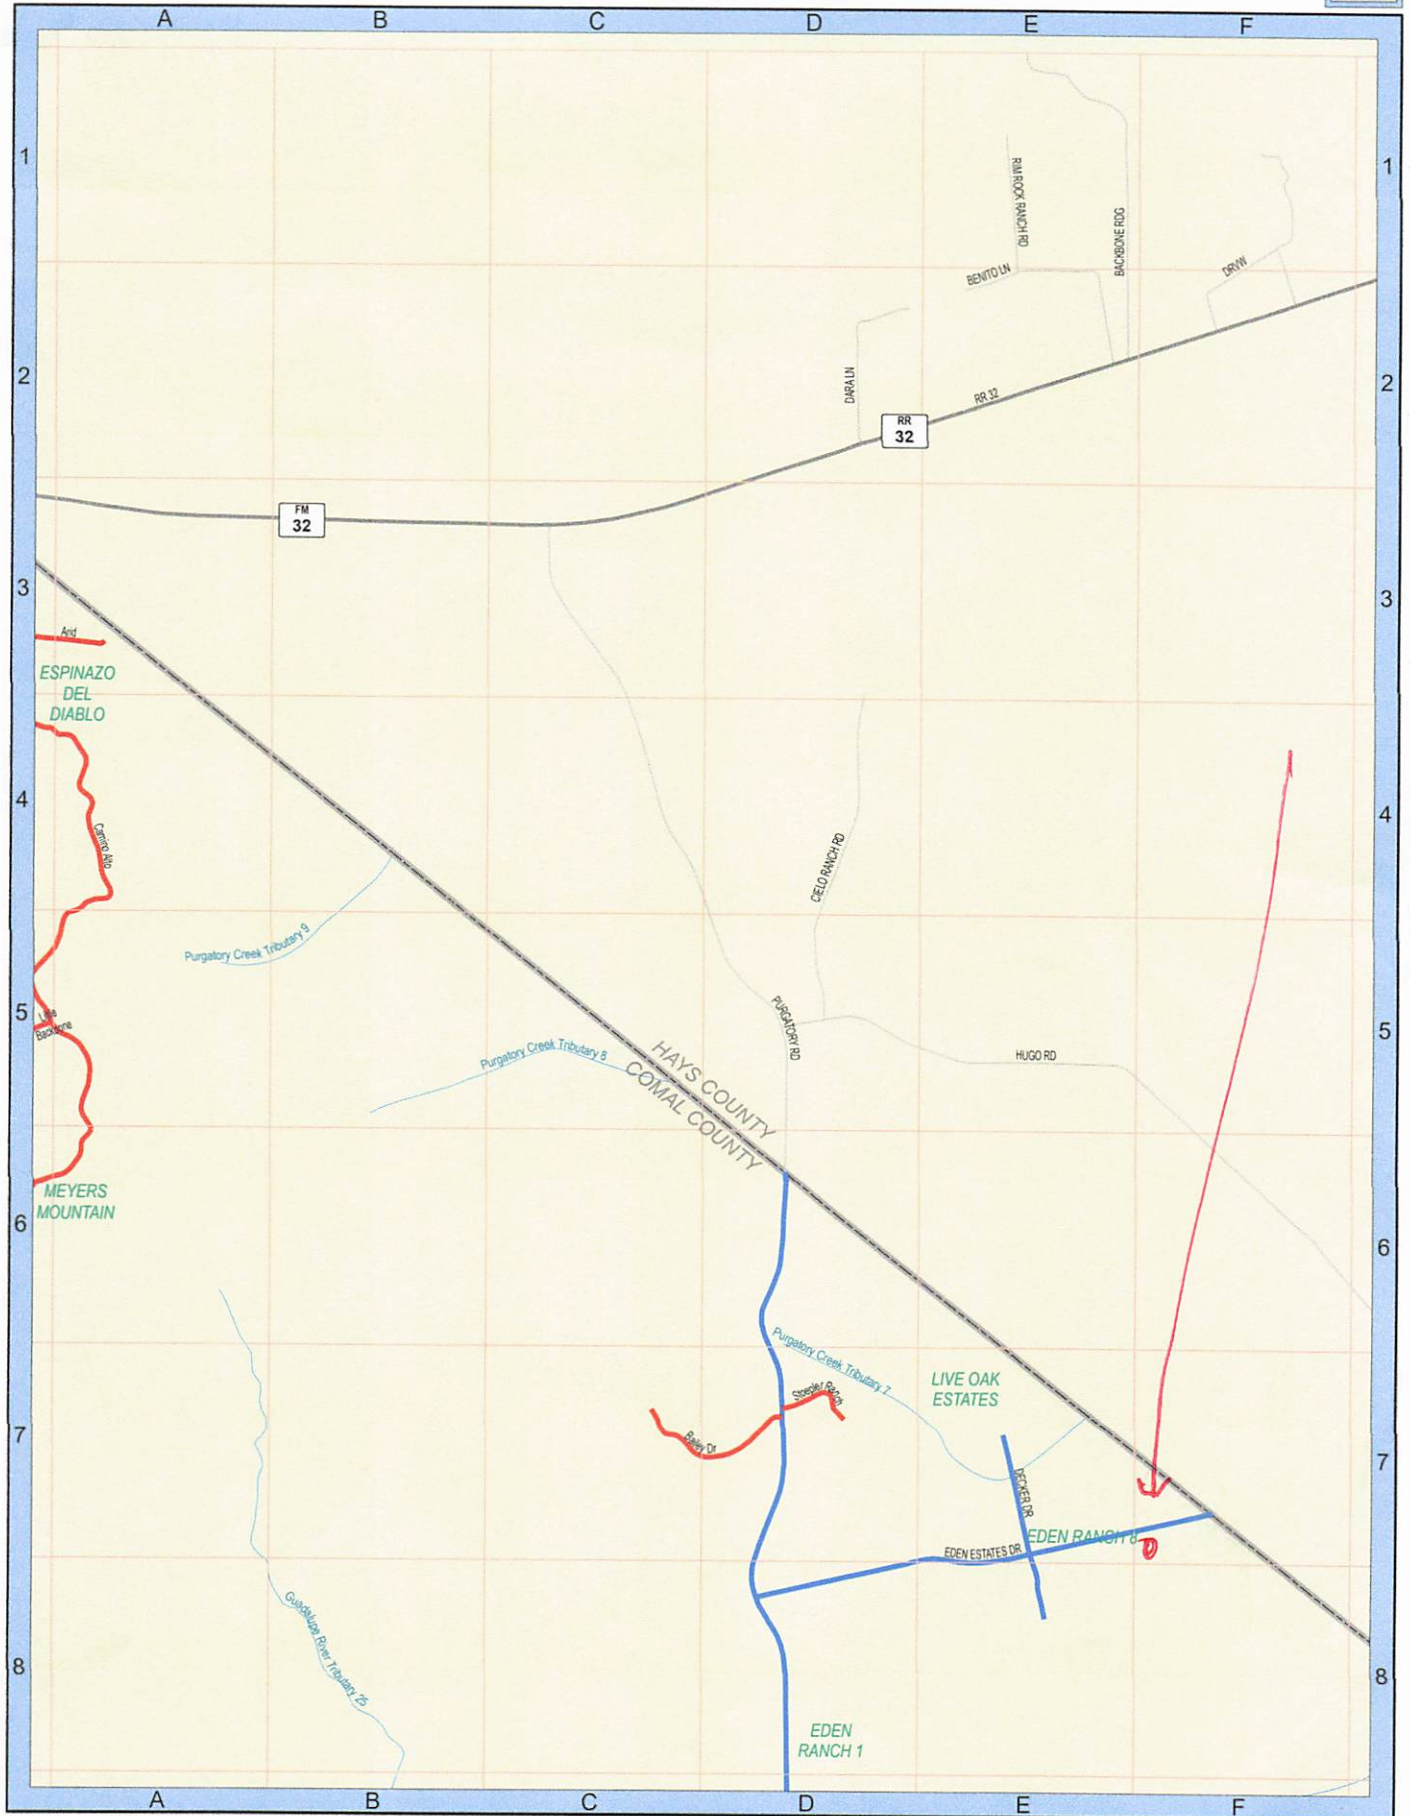

0 1,250 2,500
Feet


0 0.25 0.5
Miles

From: [Ritzen,Brenda](#)
To: [Traci Field; "\(gregjohnsonpe@yahoo.com\)"](#)
Subject: Permit 118633
Date: Thursday, May 29, 2025 1:50:00 PM
Attachments: [image001.png](#)

**Re: Barry & Jane Buchanan
Eden Ranch Section 8 Lot 13
Application for Permit for Authorization to Construct an On-Site
Sewage Facility (OSSF)**

Traci / Greg :

The following information is needed before I can continue processing the referenced permit renewal submittal:

1.  **The 2 year initial maintenance contract must indicate that the start date of the contract shall be the date the Lincese to Operate is issued, instead of LTO.**
2. **Revise as needed and resubmit.**

Thank you,



Brenda Ritzen
Environmental Health Coordinator
195 David Jonas Dr.
New Braunfels, TX 78132
DR:OS00007722
830-608-2090
www.cceo.org

VOID



By Cody Young LLC

To: BARRY & JANE BUCHANAN
EDEN RANCH, SECTION 8, LOT 13

Site: 1012 EDEN ESTATES DRIVE, NEW BRAUNFELS, TX 78132
County: COMAL COUNTY ENGINEERS OFFICE
Installer: GORDON PAUL SWOYER
Agency: COMAL COUNTY ENGINEERS OFFICE
Mfg./Brand: MAXX AIR M-600

Level 1 Contract

This service contract for the On-Site Sewage Facility (OSSF), located at the site stated above. OSSF is to be inspected and serviced at regular intervals under the terms of this contract. Special emergency service is to be provided within 48 hours of notification by the homeowner or the provider's agent. The initial contract is for (2) years from the date of final septic system inspection. Renewals shall be for a period of 2 years at the current rate and remain in effect for the specified dates listed. From LTO until 2 YEARS FROM LTO

Contract price \$700

Service Program Includes:

1. Regular site inspection at 4-month intervals for residential septic system.
2. OSSF maintenance: check aerator components for proper operation, control panel, effluent pump, spray head/drip nozzle. Check Proprietary specific components. Check pumps, check spray heads, check, and clean any Filters, check bull run valves and any other valves. Flush drain field if needed.
3. Visual inspection of control panel, (when accessible).
4. Labor expenses required at the home to maintain, repair, or remove any part of the control center or mechanical aerator to be returned for factory repair.
5. Labor expenses required at the home to service, repair, or install any part of the control panel or aerator returned from factory.
6. All maintenance reports will be emailed to the permitting authority & customer within 14 days of inspection.

VOID

Client Responsibilities:

1. Special service calls after the (at the 4-month intervals) stated in item #1.
2. BODs or TSS grab samples, (if needed).
3. Freight costs to and from factory, for component repair.
4. Costs for replacing damaged or missing parts and repairing any equipment not under any specified warranty.
5. Pumping out any or all the OSSF by a licensed waste hauler.
6. The Homeowner is responsible for maintaining the chlorinator and providing proper chlorine supply if required.
7. Securing pets so that maintenance functions can be performed safely for the technician, and the pet. If pets are present in the yard, and the owner is not on site to secure the animals, it is necessary to cancel the maintenance.
8. Securing pets so that maintenance functions can be performed safely for the technician, and the pet. If pets are present in the yard, and the owner is not on site to secure the animals, and it is necessary to cancel the maintenance, there will be a \$75 trip charge.
9. Insuring access to the property, always to the maintenance provider. (Gates, chains with locks, codes, etc.)

Miscellaneous Provisions

VOID

1. This contract can be terminated by either party in writing, within 30 days' notice. Contracts that are terminated will include notification in writing to the Authority having Jurisdiction, the Manufacturer of the system, and the other party.

Homeowner: Barry Buchanan Date: 4-1-25

Phone: 830-312-9692 Email: BUCHANANBARRY65@AOL.COM

Maintenance Provider: Milo Young, License #MP0002338



Septic Pumping & Maintenance by Cody Young

911 RR3404

Kingsland, TX 78639

(325)248-8740

FAMTC - MAIN

First American Title

GF # 1335835-BA

\$ 20.00



200906019720 06/09/2009 01:11:43 PM DEED 1/2

NOTICE OF CONFIDENTIALITY RIGHTS: IF YOU ARE A NATURAL PERSON,
↑ YOU MAY REMOVE OR STRIKE ANY OR ALL OF THE FOLLOWING
INFORMATION FROM ANY INSTRUMENT THAT TRANSFERS AN INTEREST IN
2 REAL PROPERTY BEFORE IT IS FILED FOR RECORD IN THE PUBLIC
7 RECORDS: YOUR SOCIAL SECURITY NUMBER OR YOUR DRIVER'S LICENSE
NUMBER

WARRANTY DEED WITH VENDOR'S LIEN

Date: June 8, 2009

Grantor: DONNA CAMPBELL

Grantor's Mailing Address:
(including county)

Grantee: BARRY BUCHANAN and wife, JANE BUCHANAN

Grantee's Mailing Address: 1012 Eden Estates Drive
(including county) New Braunfels, Comal County, TX 78132

Consideration: TEN AND NO/100 DOLLARS (\$10.00) and other valuable consideration and two (2) notes of even date; the first lien note in the principal amount of One Hundred Forty One Thousand Six Hundred and no/100 DOLLARS (\$141,600.00) and the second lien note in the principal amount of Twenty Six Thousand Five Hundred Fifty and 00/100 Dollars (\$26,550.00) executed by Grantee, both notes payable to the order of RANDOLPH-BROOKS FEDERAL CREDIT UNION. The notes are secured by a vendor's lien retained in favor of RANDOLPH-BROOKS FEDERAL CREDIT UNION in this deed and by two (2) deeds of trust of even date from Grantee to MORTON W. BAIRD II, Trustee

Property (including any improvements):

Lot 13, Eden Ranch, Section 8, Comal County, Texas, according to map or plat thereof recorded in Volume 9, Page 360, of the Map and Plat Records and by affidavit ratifying final plat recorded in Volume 761, Page 874 and Volume 768, Page 156, Official Public Records of Comal County, Texas.

Reservations from and Exceptions to Conveyance and Warranty:

This conveyance is made subject to any easements, conditions, mandatory homeowners assessments, and/or restrictions of record affecting the title to the hereinbefore described property.

Grantor, for the consideration and subject to the reservations from and exceptions to conveyance and warranty, grants, sells, and conveys to Grantee the property, together with all and singular the rights and appurtenances thereto in any wise belonging, to have and hold it to Grantee, Grantee's heirs, executors, administrators, successors, or assigns forever. Grantor hereby binds Grantor and Grantor's heirs, executors, administrators, and successors to warrant and forever defend all and singular the property to Grantee and Grantee's heirs, executors, administrators, successors and assigns, against every person whomsoever lawfully claiming or to claim the same or any part thereof, except as to the reservations from and exceptions to conveyance and warranty.

The vendor's lien against and superior title to the property are retained until each note described is fully paid according to its terms, at which time this deed shall become absolute.

RANDOLPH-BROOKS FEDERAL CREDIT UNION, at Grantee's request, has paid in cash to Grantor that portion of the purchase price of the property that is evidenced by the notes described above. The first vendor's lien and superior title to the property are retained for the benefit of RANDOLPH-BROOKS FEDERAL CREDIT UNION and are transferred to that party. The second vendor's lien and inferior title to the property are retained for the benefit of RANDOLPH-BROOKS FEDERAL CREDIT UNION and are transferred to that party.

When the context requires, singular nouns and pronouns include the plural.

Donna Campbell
DONNA CAMPBELL

THE STATE OF TEXAS
COUNTY OF COMAL

(Acknowledgment)


This instrument was acknowledged before me on the 8th day of June, 2009,

by DONNA CAMPBELL

Notary Public, State of Texas

Notary's Name (printed)

Notary's commission expires

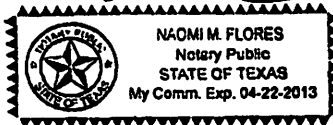

AFTER RECORDING RETURN TO:

BARRY BUCHANAN
1012 Eden Estates Drive
New Braunfels TX 78132

PREPARED IN THE LAW OFFICE OF:

MORTON W. BAIRD II
242 W. Sunset Suite 201
San Antonio, Texas 78209

Filed and Recorded
Official Public Records
Joy Streater, County Clerk
Comal County, Texas
06/09/2009 01:11:43 PM
CASHONE
200906019720



Joy Streater

RECEIVED

By Kathy Griffin at 12:33 pm, May 13, 2025



COMAL COUNTY
ENGINEER'S OFFICE

**OSSF DEVELOPMENT APPLICATION
CHECKLIST**

Staff will complete shaded items

--	--

Date Received

Initials

118633

Permit Number

Instructions:

Place a check mark next to all items that apply. For items that do not apply, place "N/A". This OSSF Development Application Checklist **must** accompany the completed application.

OSSF Permit

- ☒ Completed Application for Permit for Authorization to Construct an On-Site Sewage Facility and License to Operate
- ☒ Site/Soil Evaluation Completed by a Certified Site Evaluator or a Professional Engineer
- ☒ Planning Materials of the OSSF as Required by the TCEQ Rules for OSSF Chapter 285. Planning Materials shall consist of a scaled design and all system specifications.
- ☒ Required Permit Fee - See Attached Fee Schedule
- ☒ Copy of Recorded Deed
- ☒ Surface Application/Aerobic Treatment System
 - ☒ Recorded Certification of OSSF Requiring Maintenance/Affidavit to the Public
 - ☒ Signed Maintenance Contract with Effective Date as Issuance of License to Operate

I affirm that I have provided all information required for my OSSF Development Application and that this application constitutes a completed OSSF Development Application.

Signature of Applicant

05/11/2025

Date

___ COMPLETE APPLICATION

Check No. _____ Receipt No. _____

INCOMPLETE APPLICATION

___ (Missing Items Circled, Application Refused)